



# PLC I/O Interface Wiring System Selection

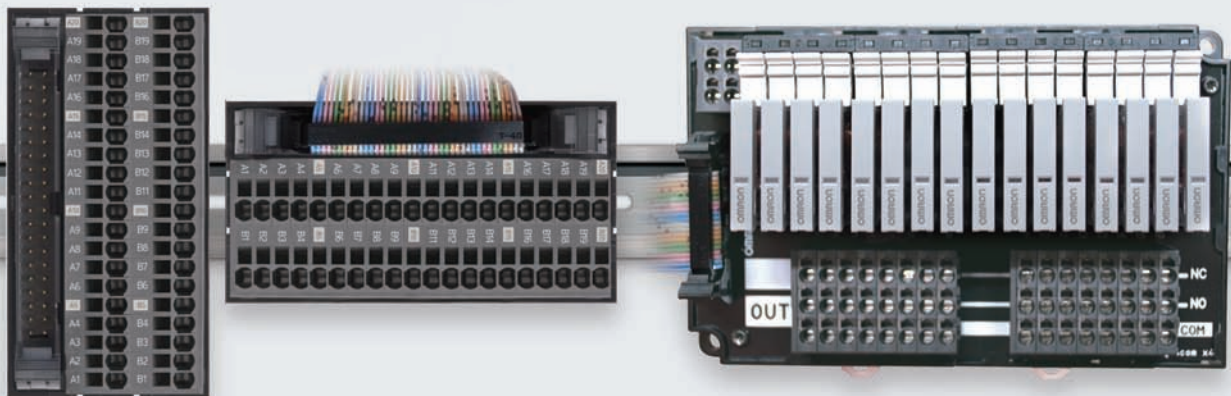

# Table of Interface Wiring System and connectable device combinations

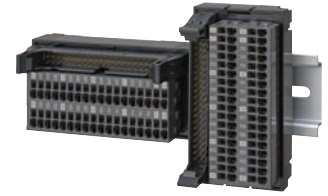

This catalogue Page 2 to 19 shows a table of the patterns and combinations in which interface wiring system and connectable devices (PLC I/O units, DeviceNet Units) can be connected. For the detailed specifications and connection diagrams of each device, see the data sheet of the related product.

## Connection type pattern

Pattern	Configuration
A	<p>Diagram A shows a single interface wiring system (represented by a horizontal row of terminals) connected to a device (represented by a vertical rectangle with a slot). A connecting cable is shown as a line between the device and the wiring system.</p>
B	<p>Diagram B shows a central interface wiring system connected to two separate devices. A connecting cable branches from the wiring system to each device.</p>
C	<p>Diagram C shows a central interface wiring system connected to four devices. A connecting cable with two branches splits to connect to two devices on the left and two on the right.</p>
D	<p>Diagram D shows a central interface wiring system connected to seven devices. A connecting cable with three branches splits to connect to three devices in the top row and four in the bottom row.</p>

## For Omron PLC NX Series

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
NX-ID5142-5	16 inputs	1 MIL connector (20)	NPN/ PNP	A	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016A-IN *2	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
NX-ID6142-5	32 inputs	1 MIL connector (40)	NPN/ PNP	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-IN *2	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C2	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C2	Slotted screw (rise up)	No
					XW2Z-100K	XW2R-N32GD-C2-COM *2	e-CON	Yes
NX-ID6142-6	32 inputs	1 Fujitsu/ Otax connector (40)	NPN/ PNP	A	XW2Z-100B	XW2K-40G-032A	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032A-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C1	Slotted screw (rise up)	No
					XW2Z-100B	XW2R-N32GD-C1-COM *2	e-CON	Yes
NX-OD5121-5	16 outputs	1 MIL connector (20)	NPN	A	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016B-OUT	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
NX-OD5256-5	16 outputs	1 MIL connector (20)	NPN	A	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016B-OUT	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
NX-OD6121-5	32 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-OUT	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C4	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C4	Slotted screw (rise up)	No
NX-OD6121-6	32 outputs	1 Fujitsu/ Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-032B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No
NX-OD6256-5	32 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-OUT	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C4	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C4	Slotted screw (rise up)	No

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
NX-MD6121-5	16 inputs	1 MIL connector (20)	NPN/ PNP	B	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016A-IN *2	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
	16 outputs	1 MIL connector (20)	NPN		XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016B-OUT	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
NX-MD6121-6	16 inputs	1 Fujitsu/Otax connector (24)	NPN/ PNP	B	XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2K-20G-016A-IN *2	Push-In Plus	Yes
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
	16 outputs	1 Fujitsu/Otax connector (24)	NPN		XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2K-20G-016B-OUT	Push-In Plus	Yes
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
NX-MD6256-5	16 inputs	1 MIL connector (20)	NPN/ PNP	B	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016A-IN *2	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
	16 outputs	1 MIL connector (20)	NPN		XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016B-OUT	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.

## For Omron PLC CJ Series

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CJ1W-ID231	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	A	XW2Z-100B	XW2K-40G-032A	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032A-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C1	Slotted screw (rise up)	No
					XW2Z-100B	XW2R-N32GD-C1-COM *2	e-CON	Yes
CJ1W-ID232	32 inputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-IN *2	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C2	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C2	Slotted screw (rise up)	No
					XW2Z-100K	XW2R-N32GD-C2-COM *2	e-CON	Yes
CJ1W-ID233	32 inputs	1 MIL connector (40)	NPN/ PNP	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-IN *2	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C2	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C2	Slotted screw (rise up)	No
					XW2Z-100K	XW2R-N32GD-C2-COM *2	e-CON	Yes
CJ1W-ID261	64 inputs	2 Fujitsu/Otax connectors (40)	NPN	B	XW2Z-100B (2 cable)	XW2K-40G-032A (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-032A-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-C1 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-C1 (2 pcs)	Slotted screw (rise up)	No
					XW2Z-100B (2 cable)	XW2R-N32GD-C1-COM (2 pcs) *2	e-CON	Yes
CJ1W-ID262	64 inputs	2 MIL connectors (40)	NPN/ PNP	B	XW2Z-100K (2 cable)	XW2K-40G-032C (2 pcs)	Push-In Plus	No
					XW2Z-100K (2 cable)	XW2K-40G-032C-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100K (2 cable)	XW2R-J34GD-C2 (2 pcs)	Phillips screw	No
					XW2Z-100K (2 cable)	XW2R-E34GD-C2 (2 pcs)	Slotted screw (rise up)	No
					XW2Z-100K (2 cable)	XW2R-N32GD-C2-COM (2 pcs) *2	e-CON	Yes
CJ1W-OD231	32 outputs	1 Fujitsu/Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-032B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No
CJ1W-OD232	32 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-OUT	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C4	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C4	Slotted screw (rise up)	No

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CJ1W-OD233	32 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-OUT	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C4	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C4	Slotted screw (rise up)	No
CJ1W-OD234	32 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-OUT	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C4	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C4	Slotted screw (rise up)	No
CJ1W-OD261	64 outputs	2 Fujitsu/Otax connectors (40)	NPN	B	XW2Z-100B (2 cable)	XW2K-40G-032B (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-032B-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-C3 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-C3 (2 pcs)	Slotted screw (rise up)	No
CJ1W-OD262	64 outputs	2 MIL connectors (40)	PNP	B	XW2Z-100K (2 cable)	XW2K-40G-032C (2 pcs)	Push-In Plus	No
					XW2Z-100K (2 cable)	XW2K-40G-032C-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100K (2 cable)	XW2R-J34GD-C4 (2 pcs)	Phillips screw	No
					XW2Z-100K (2 cable)	XW2R-E34GD-C4 (2 pcs)	Slotted screw (rise up)	No
CJ1W-OD263	64 outputs	2 MIL connectors (40)	NPN	B	XW2Z-100K (2 cable)	XW2K-40G-032C (2 pcs)	Push-In Plus	No
					XW2Z-100K (2 cable)	XW2K-40G-032C-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100K (2 cable)	XW2R-J34GD-C4 (2 pcs)	Phillips screw	No
					XW2Z-100K (2 cable)	XW2R-E34GD-C4 (2 pcs)	Slotted screw (rise up)	No
CJ1W-MD231	16 inputs	1 Fujitsu/Otax connector (24)	NPN/PNP	B	XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2K-20G-O16A-IN *2	Push-In Plus	Yes
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
	16 outputs	1 Fujitsu/Otax connector (24)	NPN		XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2K-20G-O16B-OUT	Push-In Plus	Yes
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
CJ1W-MD232	16 inputs	1 MIL connector (20)	NPN/PNP	B	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
	16 outputs	1 MIL connector (20)	PNP		XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No

(Continued on the next page.)

PLC I/O Unit		Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit				
Unit	I/O capacity			Number of connectors	Polarity	Model	Wiring method	Common terminal
CJ1W-MD233	16 inputs	1 MIL connector (20)	NPN/ PNP	B	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016A-IN *2	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
	16 outputs	1 MIL connector (20)	NPN		XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X-R	XW2K-20G-016B-OUT	Push-In Plus	Yes
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
CJ1W-MD261	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-032A	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032A-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C1	Slotted screw (rise up)	No
	32 outputs	1 Fujitsu/Otax connector (40)	NPN		XW2Z-100B	XW2R-N32GD-C1-COM *2	e-CON	Yes
					XW2Z-100B	XW2K-40G-032B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No					
CJ1W-MD263	32 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-IN *2	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C2	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C2	Slotted screw (rise up)	No
	32 outputs	1 MIL connector (40)	NPN		XW2Z-100K	XW2R-N32GD-C2-COM *2	e-CON	Yes
					XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-OUT	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C4	Phillips screw	No
XW2Z-100K	XW2R-E34GD-C4	Slotted screw (rise up)	No					
CJ1W-MD563	32 inputs	1 MIL connector (40)	—	B	XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-IN *2	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C2	Phillips screw	No
					XW2Z-100K	XW2R-E34GD-C2	Slotted screw (rise up)	No
	32 outputs	1 MIL connector (40)	—		XW2Z-100K	XW2R-N32GD-C2-COM *2	e-CON	Yes
					XW2Z-100K	XW2K-40G-032C	Push-In Plus	No
					XW2Z-100K	XW2K-40G-032C-OUT	Push-In Plus	Yes
					XW2Z-100K	XW2R-J34GD-C4	Phillips screw	No
XW2Z-100K	XW2R-E34GD-C4	Slotted screw (rise up)	No					

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.

## For Omron PLC CS Series

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CS1W-ID231	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	A	XW2Z-100B	XW2K-40G-032A	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032A-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C1	Slotted screw (rise up)	No
					XW2Z-100B	XW2R-N32GD-C1-COM *2	e-CON	Yes
CS1W-ID261	64 inputs	2 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-100B (2 cable)	XW2K-40G-032A (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-032A-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-C1 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-C1 (2 pcs)	Slotted screw (rise up)	No
					XW2Z-100B (2 cable)	XW2R-N32GD-C1-COM (2 pcs) *2	e-CON	Yes
CS1W-ID291	96 inputs	2 Fujitsu/Otax connector (56)	NPN/ PNP	C	XW2Z-100H-2	XW2K-20G-T + XW2K-40G-T	Push-In Plus	No
					XW2Z-100H-2	XW2D-20G6 + XW2D-40G6	Phillips screw	No
					XW2Z-100H-2	XW2R-E20GD-T + XW2R-E40GD-T	Slotted screw (rise up)	No
				D	XW2Z-100H-3	XW2K-20G-T (3 pcs)	Push-In Plus	No
					XW2Z-100H-3	XW2D-20G6 (3 pcs)	Phillips screw	No
					XW2Z-100H-3	XW2R-E20GD-T (3 pcs)	Slotted screw (rise up)	No
CS1W-OD231	32 outputs	1 Fujitsu/Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-032B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No
CS1W-OD232	32 outputs	1 Fujitsu/Otax connector (40)	PNP	A	XW2Z-100B	XW2K-40G-032B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No
CS1W-OD261	64 outputs	2 Fujitsu/Otax connector (40)	NPN	B	XW2Z-100B (2 cable)	XW2K-40G-032B (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-032B-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-C3 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-C3 (2 pcs)	Slotted screw (rise up)	No
CS1W-OD262	64 outputs	2 Fujitsu/Otax connector (40)	PNP	B	XW2Z-100B (2 cable)	XW2K-40G-032B (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-032B-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-C3 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-C3 (2 pcs)	Slotted screw (rise up)	No

(Continued on the next page.)



PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CS1W-OD291	96 outputs	2 Fujitsu/Otax connector (56)	NPN	C	XW2Z-100H-2	XW2K-20G-T + XW2K-40G-T	Push-In Plus	No
					XW2Z-100H-2	XW2D-20G6 + XW2D-40G6	Phillips screw	No
					XW2Z-100H-2	XW2R-E20GD-T + XW2R-E40GD-T	Slotted screw (rise up)	No
				D	XW2Z-100H-3	XW2K-20G-T (3 pcs)	Push-In Plus	No
					XW2Z-100H-3	XW2D-20G6 (3 pcs)	Phillips screw	No
					XW2Z-100H-3	XW2R-E20GD-T (3 pcs)	Slotted screw (rise up)	No
CS1W-OD292	96 outputs	2 Fujitsu/Otax connector (56)	PNP	C	XW2Z-100H-2	XW2K-20G-T + XW2K-40G-T	Push-In Plus	No
					XW2Z-100H-2	XW2D-20G6 + XW2D-40G6	Phillips screw	No
					XW2Z-100H-2	XW2R-E20GD-T + XW2R-E40GD-T	Slotted screw (rise up)	No
				D	XW2Z-100H-3	XW2K-20G-T (3 pcs)	Push-In Plus	No
					XW2Z-100H-3	XW2D-20G6 (3 pcs)	Phillips screw	No
					XW2Z-100H-3	XW2R-E20GD-T (3 pcs)	Slotted screw (rise up)	No
CS1W-MD261	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-032A	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032A-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C1	Slotted screw (rise up)	No
					XW2Z-100B	XW2R-N32GD-C1-COM *2	e-CON	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	NPN		XW2Z-100B	XW2K-40G-032B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No
CS1W-MD262	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-032A	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032A-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C1	Slotted screw (rise up)	No
					XW2Z-100B	XW2R-N32GD-C1-COM *2	e-CON	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	PNP		XW2Z-100B	XW2K-40G-032B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-032B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No
					XW2Z-100B	XW2R-E34GD-C3	Slotted screw (rise up)	No

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CS1W-MD561	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-O32A	Push-In Plus	No
					XW2Z-100B	XW2K-40G-O32A-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-C1	Slotted screw (rise up)	No
	32 outputs	1 Fujitsu/Otax connector (40)	NPN		XW2Z-100B	XW2R-N32GD-C1-COM *2	e-CON	Yes
					XW2Z-100B	XW2K-40G-O32B	Push-In Plus	No
					XW2Z-100B	XW2K-40G-O32B-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-C3	Phillips screw	No
CS1W-MD291	48 inputs	1 Fujitsu/Otax connector (56)	NPN/ PNP	C	XW2Z-100H-2	XW2K-20G-T + XW2K-40G-T	Push-In Plus	No
					XW2Z-100H-2	XW2D-20G6 + XW2D-40G6	Phillips screw	No
					XW2Z-100H-2	XW2R-E20GD-T + XW2R-E40GD-T	Slotted screw (rise up)	No
				D	XW2Z-100H-3	XW2K-20G-T (3 pcs)	Push-In Plus	No
					XW2Z-100H-3	XW2D-20G6 (3 pcs)	Phillips screw	No
					XW2Z-100H-3	XW2R-E20GD-T (3 pcs)	Slotted screw (rise up)	No
	48 outputs	1 Fujitsu/Otax connector (56)	NPN	C	XW2Z-100H-2	XW2K-20G-T + XW2K-40G-T	Push-In Plus	No
					XW2Z-100H-2	XW2D-20G6 + XW2D-40G6	Phillips screw	No
					XW2Z-100H-2	XW2R-E20GD-T + XW2R-E40GD-T	Slotted screw (rise up)	No
D				XW2Z-100H-3	XW2K-20G-T (3 pcs)	Push-In Plus	No	
				XW2Z-100H-3	XW2D-20G6 (3 pcs)	Phillips screw	No	
				XW2Z-100H-3	XW2R-E20GD-T (3 pcs)	Slotted screw (rise up)	No	
CS1W-MD292	48 inputs	1 Fujitsu/Otax connector (56)	NPN/ PNP	C	XW2Z-100H-2	XW2K-20G-T + XW2K-40G-T	Push-In Plus	No
					XW2Z-100H-2	XW2D-20G6 + XW2D-40G6	Phillips screw	No
					XW2Z-100H-2	XW2R-E20GD-T + XW2R-E40GD-T	Slotted screw (rise up)	No
				D	XW2Z-100H-3	XW2K-20G-T (3 pcs)	Push-In Plus	No
					XW2Z-100H-3	XW2D-20G6 (3 pcs)	Phillips screw	No
					XW2Z-100H-3	XW2R-E20GD-T (3 pcs)	Slotted screw (rise up)	No
	48 outputs	1 Fujitsu/Otax connector (56)	PNP	C	XW2Z-100H-2	XW2K-20G-T + XW2K-40G-T	Push-In Plus	No
					XW2Z-100H-2	XW2D-20G6 + XW2D-40G6	Phillips screw	No
					XW2Z-100H-2	XW2R-E20GD-T + XW2R-E40GD-T	Slotted screw (rise up)	No
D				XW2Z-100H-3	XW2K-20G-T (3 pcs)	Push-In Plus	No	
				XW2Z-100H-3	XW2D-20G6 (3 pcs)	Phillips screw	No	
				XW2Z-100H-3	XW2R-E20GD-T (3 pcs)	Slotted screw (rise up)	No	

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.

## For Omron DeviceNet Slave

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
DRT2-ID16ML	16 inputs	1 MIL connector (20)	NPN	A	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
DRT2-ID16ML-1	16 inputs	1 MIL connector (20)	PNP	A	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
DRT2-ID32ML	32 inputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-ID32ML-1	32 inputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-OD16ML	16 outputs	1 MIL connector (20)	NPN	A	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
DRT2-OD16ML-1	16 outputs	1 MIL connector (20)	PNP	A	XW2Z-100X	XW2K-20G-T	Push-In Plus	No
					XW2Z-100X	XW2D-20G6	Phillips screw	No
					XW2Z-100X	XW2R-E20GD-T	Slotted screw (rise up)	No
DRT2-OD32ML	32 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-OD32ML-1	32 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-MD32ML	16 inputs / 16 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-MD32ML-1	16 inputs / 16 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
DRT2-ID32B	32 inputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-ID32B-1	32 inputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-OD32B	32 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-OD32B-1	32 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-MD32B	16 inputs / 16 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-MD32B-1	16 inputs / 16 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-ID32BV	32 inputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-ID32BV-1	32 inputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-OD32BV	32 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-OD32BV-1	32 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
DRT2-MD32BV	16 inputs / 16 outputs	1 MIL connector (40)	NPN	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
DRT2-MD32BV-1	16 inputs / 16 outputs	1 MIL connector (40)	PNP	A	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
GT1-ID16ML	16 inputs	1 Fujitsu/Otax connector (24)	NPN	A	XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
GT1-ID16ML-1	16 inputs	1 Fujitsu/Otax connector (24)	PNP	A	XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
GT1-ID32ML	32 inputs	1 Fujitsu/Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-T	Push-In Plus	No
					XW2Z-100B	XW2D-40G6	Phillips screw	No
					XW2Z-100B	XW2R-E40GD-T	Slotted screw (rise up)	No
GT1-ID32ML-1	32 inputs	1 Fujitsu/Otax connector (40)	PNP	A	XW2Z-100B	XW2K-40G-T	Push-In Plus	No
					XW2Z-100B	XW2D-40G6	Phillips screw	No
					XW2Z-100B	XW2R-E40GD-T	Slotted screw (rise up)	No
GT1-OD16ML	16 outputs	1 Fujitsu/Otax connector (24)	NPN	A	XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
GT1-OD16ML-1	16 outputs	1 Fujitsu/Otax connector (24)	PNP	A	XW2Z-100A	XW2K-20G-T	Push-In Plus	No
					XW2Z-100A	XW2D-20G6	Phillips screw	No
					XW2Z-100A	XW2R-E20GD-T	Slotted screw (rise up)	No
GT1-OD32ML	32 outputs	1 Fujitsu/Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-T	Push-In Plus	No
					XW2Z-100B	XW2D-40G6	Phillips screw	No
					XW2Z-100B	XW2R-E40GD-T	Slotted screw (rise up)	No
GT1-OD32ML-1	32 outputs	1 Fujitsu/Otax connector (40)	PNP	A	XW2Z-100B	XW2K-40G-T	Push-In Plus	No
					XW2Z-100B	XW2D-40G6	Phillips screw	No
					XW2Z-100B	XW2R-E40GD-T	Slotted screw (rise up)	No

\* 1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

## For Mitsubishi Electric PLC MELSEC L Series

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
LX41C4	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M1	Slotted screw (rise up)	No
LX42C4	64 inputs	2 Fujitsu/Otax connectors (40)	NPN/ PNP	B	XW2Z-100B (2 cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-M32-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-M1 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-M1 (2 pcs)	Slotted screw (rise up)	No
LY41NT1P	32 outputs	1 Fujitsu/Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No
LY41PT1P	32 outputs	1 Fujitsu/Otax connector (40)	PNP	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No
LY42NT1P	64 outputs	2 Fujitsu/Otax connectors (40)	NPN	B	XW2Z-100B (2 cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-M32-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-M2 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-M2 (2 pcs)	Slotted screw (rise up)	No
LY42PT1P	64 outputs	2 Fujitsu/Otax connectors (40)	PNP	B	XW2Z-100B (2 cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2R-J34GD-M2 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-M2 (2 pcs)	Slotted screw (rise up)	No
LH42C4NT1P	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M1	Slotted screw (rise up)	No
	32 outputs	1 Fujitsu/Otax connector (40)	NPN		XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
LH42C4PT1P	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M1	Slotted screw (rise up)	No
	32 outputs	1 Fujitsu/Otax connector (40)	PNP		XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.

## For Mitsubishi Electric PLC MELSEC Q Series

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
QX41 QX41-S1 QX41-S2 QX71	32 inputs	1 Fujitsu/ Otax connector (40)	NPN/ PNP	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M1	Slotted screw (rise up)	No
QX42 QX42-S1 QX72 QX82 QX82-S1	64 inputs	2 Fujitsu/ Otax connectors (40)	NPN/ PNP	B	XW2Z-100B (2 cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-M32-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-M1 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-M1 (2 pcs)	Slotted screw (rise up)	No
QY41P QY71	32 outputs	1 Fujitsu/ Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-OUT *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No
QY42P	64 outputs	2 Fujitsu/ Otax connectors (40)	NPN	B	XW2Z-100B (2 cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2K-40G-M32-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100B (2 cable)	XW2R-J34GD-M2 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-M2 (2 pcs)	Slotted screw (rise up)	No
QY82P	64 outputs	2 Fujitsu/ Otax connectors (40)	PNP	B	XW2Z-100B (2 cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2 cable)	XW2R-J34GD-M2 (2 pcs)	Phillips screw	No
					XW2Z-100B (2 cable)	XW2R-E34GD-M2 (2 pcs)	Slotted screw (rise up)	No
QH42P QX41Y41P	32 inputs	1 Fujitsu/ Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M1	Slotted screw (rise up)	No
	32 outputs	1 Fujitsu/ Otax connector (40)	NPN		XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.

## For Mitsubishi Electric PLC MELSEC iQ-R Series

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
RX41C4 RX71C4 RX41C6HS RX61C6HS	32 inputs	1 Fujitsu/ Otax connector (40)	NPN/ PNP	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M1	Slotted screw (rise up)	No
RX42C4 RX72C4	64 inputs	2 Fujitsu/ Otax connectors (40)	NPN/ PNP	B	XW2Z-100B (2Cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2Cable)	XW2K-40G-M32-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100B (2Cable)	XW2R-J34GD-M1 (2 pcs)	Phillips screw	No
					XW2Z-100B (2Cable)	XW2R-E34GD-M1 (2 pcs)	Slotted screw (rise up)	No
RY41NT2P RY41NT2H	32 outputs	1 Fujitsu/ Otax connector (40)	NPN	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No
RY41PT1P RY41PT2H	32 outputs	1 Fujitsu/ Otax connector (40)	PNP	A	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No
RY42NT2P	64 outputs	2 Fujitsu/ Otax connectors (40)	NPN	B	XW2Z-100B (2Cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2Cable)	XW2K-40G-M32-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100B (2Cable)	XW2R-J34GD-M2 (2 pcs)	Phillips screw	No
					XW2Z-100B (2Cable)	XW2R-E34GD-M2 (2 pcs)	Slotted screw (rise up)	No
RY42PT1P	64 outputs	2 Fujitsu/ Otax connectors (40)	PNP	B	XW2Z-100B (2Cable)	XW2K-40G-M32 (2 pcs)	Push-In Plus	No
					XW2Z-100B (2Cable)	XW2R-J34GD-M2 (2 pcs)	Phillips screw	No
					XW2Z-100B (2Cable)	XW2R-E34GD-M2 (2 pcs)	Slotted screw (rise up)	No
RH42C4NT2P	32 inputs	1 Fujitsu/ Otax connector (40)	NPN/ PNP	B	XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-IN *2	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M1	Phillips screw	No
					XW2Z-100B	XW2R-E34GD-M1	Slotted screw (rise up)	No
	32 outputs	1 Fujitsu/ Otax connector (40)	NPN		XW2Z-100B	XW2K-40G-M32	Push-In Plus	No
					XW2Z-100B	XW2K-40G-M32-OUT	Push-In Plus	Yes
					XW2Z-100B	XW2R-J34GD-M2	Phillips screw	No
XW2Z-100B	XW2R-E34GD-M2	Slotted screw (rise up)	No					

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.



## For KEYENCE PLC KV Series

PLC I/O Unit		Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit				
Unit	I/O capacity			Number of connectors	Polarity	Model	Wiring method	Common terminal
KV-C32XA	32 inputs	1 MIL connector (34)	NPN/ PNP	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-IN *2	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-C32XC	32 inputs	1 MIL connector (34)	NPN/ PNP	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-IN *2	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-C64XA	64 inputs	2 MIL connectors (34)	NPN/ PNP	B	XW2Z-100EE (2 cable)	XW2K-34G-K32 (2 pcs)	Push-In Plus	No
					XW2Z-100EE (2 cable)	XW2K-34G-K32-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100EE (2 cable)	XW2R-J34GD-K1 (2 pcs)	Phillips screw	No
					XW2Z-100EE (2 cable)	XW2R-E34GD-K1 (2 pcs)	Slotted screw (rise up)	No
KV-C64XC	64 inputs	2 MIL connectors (34)	NPN/ PNP	B	XW2Z-100EE (2 cable)	XW2K-34G-K32 (2 pcs)	Push-In Plus	No
					XW2Z-100EE (2 cable)	XW2K-34G-K32-IN (2 pcs) *2	Push-In Plus	Yes
					XW2Z-100EE (2 cable)	XW2R-J34GD-K1 (2 pcs)	Phillips screw	No
					XW2Z-100EE (2 cable)	XW2R-E34GD-K1 (2 pcs)	Slotted screw (rise up)	No
KV-C32TA	32 outputs	1 MIL connector (34)	NPN	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-OUT	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-C32TC	32 outputs	1 MIL connector (34)	NPN	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-OUT	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-C32TD	32 outputs	1 MIL connector (34)	NPN	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-OUT	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-C32TCP	32 outputs	1 MIL connector (34)	PNP	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-C64TA	64 outputs	2 MIL connectors (34)	NPN	B	XW2Z-100EE (2 cable)	XW2K-34G-K32 (2 pcs)	Push-In Plus	No
					XW2Z-100EE (2 cable)	XW2K-34G-K32-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100EE (2 cable)	XW2R-J34GD-K1 (2 pcs)	Phillips screw	No
					XW2Z-100EE (2 cable)	XW2R-E34GD-K1 (2 pcs)	Slotted screw (rise up)	No

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
KV-C64TC	64 outputs	2 MIL connectors (34)	NPN	B	XW2Z-100EE (2 cable)	XW2K-34G-K32 (2 pcs)	Push-In Plus	No
					XW2Z-100EE (2 cable)	XW2K-34G-K32-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100EE (2 cable)	XW2R-J34GD-K1 (2 pcs)	Phillips screw	No
					XW2Z-100EE (2 cable)	XW2R-E34GD-K1 (2 pcs)	Slotted screw (rise up)	No
KV-C64TD	64 outputs	2 MIL connectors (34)	NPN	B	XW2Z-100EE (2 cable)	XW2K-34G-K32 (2 pcs)	Push-In Plus	No
					XW2Z-100EE (2 cable)	XW2K-34G-K32-OUT (2 pcs)	Push-In Plus	Yes
					XW2Z-100EE (2 cable)	XW2R-J34GD-K1 (2 pcs)	Phillips screw	No
					XW2Z-100EE (2 cable)	XW2R-E34GD-K1 (2 pcs)	Slotted screw (rise up)	No
KV-C64TCP	64 outputs	2 MIL connectors (34)	PNP	B	XW2Z-100EE (2 cable)	XW2K-34G-K32 (2 pcs)	Push-In Plus	No
					XW2Z-100EE (2 cable)	XW2R-J34GD-K1 (2 pcs)	Phillips screw	No
					XW2Z-100EE (2 cable)	XW2R-E34GD-K1 (2 pcs)	Slotted screw (rise up)	No
KV-C16XTD	16 inputs / 16 outputs	1 MIL connector (34)	NPN	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2D-34G6	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-T	Slotted screw (rise up)	No
KV-C32XTD	32 inputs	1 MIL connector (34)	NPN/ PNP	B	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-IN *2	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
	32 outputs	1 MIL connector (34)	NPN		XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-OUT	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-SIR32XT	32 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No
	32 outputs	1 MIL connector (40)	NPN		XW2Z-100K	XW2K-40G-T	Push-In Plus	No
					XW2Z-100K	XW2D-40G6	Phillips screw	No
					XW2Z-100K	XW2R-E40GD-T	Slotted screw (rise up)	No

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.

## For KEYENCE PLC KV Nano Series

PLC I/O Unit				Connection pattern (page 2)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
KV-NC32EX	32 inputs	1 MIL connector (34)	NPN/ PNP	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-IN *2	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-NC32ET	32 outputs	1 MIL connector (34)	NPN	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-OUT	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
KV-NC16EXT	16 inputs / 16 outputs	1 MIL connector (34)	NPN	A	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2D-34G6	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-T	Slotted screw (rise up)	No
KV-NC32EXT	32 inputs	1 MIL connector (34)	NPN/ PNP	B	XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-IN *2	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No
	32 outputs	1 MIL connector (34)	NPN		XW2Z-100EE	XW2K-34G-K32	Push-In Plus	No
					XW2Z-100EE	XW2K-34G-K32-OUT	Push-In Plus	Yes
					XW2Z-100EE	XW2R-J34GD-K1	Phillips screw	No
					XW2Z-100EE	XW2R-E34GD-K1	Slotted screw (rise up)	No

Note: 1. This table of Interface Wiring System and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 38 for details.

\*2. This Connector-Terminal Block Conversion Unit is for NPN. For PNP, reverse the polarity of the external power supply and I/O on the Connector-Terminal Block Conversion Unit.

# Table of I/O Relay Terminal and connectable device combinations



G70V/G7TC/G70A/G70D

This catalogue Page 20 to 37 shows a table of the patterns and combinations in which I/O Relay Terminal and connectable devices (PLC I/O units, DeviceNet Units) can be connected. For the detailed specifications and connection diagrams of each device, see the data sheet of the related product.

## Connection type pattern

Pattern	Configuration
A	<p>Diagram A shows a PLC I/O unit at the top connected to a single I/O Relay Terminal at the bottom. A Connecting Cable links the two components.</p>
B	<p>Diagram B shows a PLC I/O unit at the top connected to two I/O Relay Terminals, one on the left and one on the right. A Connecting Cable links the PLC I/O unit to both terminals.</p>
C	<p>Diagram C shows a PLC I/O unit at the top connected to two I/O Relay Terminals, one on the left and one on the right. A Connecting Cable links the PLC I/O unit to both terminals.</p>
D	<p>Diagram D shows a PLC I/O unit at the top connected to four I/O Relay Terminals. Two terminals are on the left and two are on the right. A Connecting Cable links the PLC I/O unit to all four terminals.</p>
E	<p>Diagram E shows a PLC I/O unit at the top connected to six I/O Relay Terminals. Three terminals are on the left and three are on the right. A Connecting Cable links the PLC I/O unit to all six terminals.</p>

## For Omron PLC NX Series

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
NX-ID5142-5	16 inputs	1 MIL connector (20)	NPN	A	XW2Z-R050C	G7TC-ID16	Phillips screw	No
					XW2Z-R050C	G7TC-IA16	Phillips screw	No
					XW2Z-R050C	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-R050C	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-R050C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-R050C	G70V-SID16P-1-C16	Push-In Plus	Yes
NX-ID6142-5	32 inputs	1 MIL connector (40)	NPN	C	XW2Z-R0100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-R0100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-R0100-75-D1	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-R0100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-R0100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-R0100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
NX-ID6142-6	32 inputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RI100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-RI100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
NX-OD5121-5	16 outputs	1 MIL connector (20)	NPN	A	XW2Z-R050C	G7TC-OC16	Phillips screw	No
					XW2Z-R050C	G70D-SOC16	Phillips screw	No
					XW2Z-R050C	G70D-FOM16	Phillips screw	No
					XW2Z-R050C	G70D-VSOC16	Phillips screw	No
					XW2Z-R050C	G70D-VFOM16	Phillips screw	No
					XW2Z-R050C	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R050C	G70V-SOC16P	Push-In Plus	No
					XW2Z-R050C	G70V-SOC16P-C4	Push-In Plus	Yes
NX-OD5256-5	16 outputs	1 MIL connector (20)	PNP	A	XW2Z-RI100C	G7TC-OC16-1	Phillips screw	No
					XW2Z-R050C	G70D-SOC16-1	Phillips screw	No
					XW2Z-R050C	G70D-FOM16-1	Phillips screw	No
					XW2Z-R050C	G70A-ZOC16-4	Phillips screw	No
					XW2Z-R050C	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-R050C	G70V-SOC16P-1-C4	Push-In Plus	Yes

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
NX-OD6121-5	32 outputs	1 MIL connector (40)	NPN	C	XW2Z-RO100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-FOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes
NX-OD6121-6	32 outputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RO100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-SOC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-FOM16	Phillips screw	No
					XW2Z-RO100C-75	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100C-75	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75	G70V-SOC16P-C4	Push-In Plus	Yes
NX-OD6256-5	32 outputs	1 MIL connector (40)	PNP	C	XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
NX-MD6121-5	16 inputs	1 MIL connector (20)	NPN	B	XW2Z-RO50C	G7TC-ID16	Phillips screw	No
					XW2Z-RO50C	G7TC-IA16	Phillips screw	No
					XW2Z-RO50C	G70V-SID16P	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RO50C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-1-C16	Push-In Plus	Yes
	16 outputs	1 MIL connector (20)	NPN	B	XW2Z-RO50C	G7TC-OC16	Phillips screw	No
					XW2Z-RO50C	G70D-SOC16	Phillips screw	No
					XW2Z-RO50C	G70D-FOM16	Phillips screw	No
					XW2Z-RO50C	G70D-VSOC16	Phillips screw	No
					XW2Z-RO50C	G70D-VFOM16	Phillips screw	No
					XW2Z-RO50C	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO50C	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO50C	G70V-SOC16P-C4	Push-In Plus	Yes

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
NX-MD6121-6	16 inputs	1 Fujitsu/Otax connector (24)	NPN	B	XW2Z-R100C	G7TC-IA16	Phillips screw	No
					XW2Z-R100C	G7TC-ID16	Phillips screw	No
					XW2Z-R100C	G70V-SID16P	Push-In Plus	No
					XW2Z-R100C	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-R050C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-R050C	G70V-SID16P-1-C16	Push-In Plus	Yes
	16 outputs	1 Fujitsu/Otax connector (24)	NPN		XW2Z-R050C	G7TC-OC16	Phillips screw	No
					XW2Z-R100C	G70D-SOC16	Phillips screw	No
					XW2Z-R100C	G70D-FOM16	Phillips screw	No
					XW2Z-R100C	G70D-VSOC16	Phillips screw	No
					XW2Z-R100C	G70D-VFOM16	Phillips screw	No
					XW2Z-R100C	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R100C	G70V-SOC16P	Push-In Plus	No
					XW2Z-R100C	G70V-SOC16P-C4	Push-In Plus	Yes
NX-MD6256-5	16 inputs	1 MIL connector (20)	PNP	B	XW2Z-R050C	G7TC-IA16	Phillips screw	No
					XW2Z-R050C	G7TC-ID16	Phillips screw	No
					XW2Z-R050C	G70V-SID16P	Push-In Plus	No
					XW2Z-R050C	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-R050C	G70V-SID16P-1	Push-In Plus	No
	16 outputs	1 MIL connector (20)	PNP		XW2Z-R050C	G70V-SID16P-1-C16	Push-In Plus	Yes
					XW2Z-R050C	G7TC-OC16-1	Phillips screw	No
					XW2Z-RI100C	G70D-SOC16-1	Phillips screw	No
					XW2Z-RI100C	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RI100C	G70V-SOC16P-1	Push-In Plus	No
XW2Z-RI100C	G70V-SOC16P-1-C4	Push-In Plus	Yes					

Note: 1. This Table of I/O Relay Terminal and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. The cable length of the XW2Z-R050C is 0.5 m. Refer to the section from page 40 for details.

## For Omron PLC CJ Series

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CJ1W-ID231	32 inputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RI100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-RI100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
CJ1W-ID232	32 inputs	1 MIL connector (40)	NPN	C	XW2Z-RO100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RO100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-RO100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
CJ1W-ID233	32 inputs	1 MIL connector (40)	NPN	C	XW2Z-RO100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RO100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-RO100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
CJ1W-ID261	64 inputs	2 Fujitsu/Otax connectors (40)	NPN	D	XW2Z-RI100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-RI100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
CJ1W-ID262	64 inputs	2 MIL connectors (40)	NPN	D	XW2Z-RO100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RO100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-RO100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes

(Continued on the next page.)



PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CJ1W-OD231	32 outputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-R0100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-SOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-FOM16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VSOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VFOM16	Phillips screw	No
					XW2Z-R0100C-75	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R0100C-75	G70V-SOC16P	Push-In Plus	No
CJ1W-OD232	32 outputs	1 MIL connector (40)	PNP	C	XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-R0100-75-D1	G70A-ZOC16-4	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-SOC16-1	Phillips screw	No
CJ1W-OD233	32 outputs	1 MIL connector (40)	NPN	C	XW2Z-R0100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-SOC16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-FOM16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-VSOC16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-VFOM16	Phillips screw	No
					XW2Z-R0100-75-D1	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R0100-75-D1	G70V-SOC16P	Push-In Plus	No
CJ1W-OD234	32 outputs	1 MIL connector (40)	NPN	C	XW2Z-R0100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-SOC16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-FOM16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-VSOC16	Phillips screw	No
					XW2Z-R0100-75-D1	G70D-VFOM16	Phillips screw	No
					XW2Z-R0100-75-D1	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R0100-75-D1	G70V-SOC16P	Push-In Plus	No
					XW2Z-R0100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes
CJ1W-OD261	64 outputs	2 Fujitsu/Otax connectors (40)	NPN	D	XW2Z-R0100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-SOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-FOM16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VSOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VFOM16	Phillips screw	No
					XW2Z-R0100C-75	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R0100C-75	G70V-SOC16P	Push-In Plus	No
					XW2Z-R0100C-75	G70V-SOC16P-C4	Push-In Plus	Yes

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CJ1W-OD262	64 outputs	2 MIL connectors (40)	PNP	D	XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1-C4	Push-In Plus	Yes
CJ1W-OD263	64 outputs	2 MIL connectors (40)	NPN	D	XW2Z-RO100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-FOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P	Push-In Plus	No
XW2Z-RO100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes					
CJ1W-MD231	16 inputs	1 Fujitsu/Otax connector (24)	NPN/ PNP	B	XW2Z-R100C	G7TC-IA16	Phillips screw	No
					XW2Z-R100C	G7TC-ID16	Phillips screw	No
					XW2Z-R100C	G70V-SID16P	Push-In Plus	No
					XW2Z-R100C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-R100C	G70V-SID16P-C16	Push-In Plus	Yes
	XW2Z-R100C	G70V-ZID16P-1-C16	Push-In Plus		Yes			
	16 outputs	1 Fujitsu/Otax connector (24)	NPN		XW2Z-R100C	G7TC-OC16	Phillips screw	No
					XW2Z-R100C	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R100C	G70V-SOC16P	Push-In Plus	No
					XW2Z-R100C	G70V-SOC16P-C4	Push-In Plus	Yes
XW2Z-R100C				G70V-SOC16P-C4	Push-In Plus	Yes		
CJ1W-MD232	16 inputs	1 MIL connector (20)	NPN/ PNP	B	XW2Z-RO50C	G7TC-IA16	Phillips screw	No
					XW2Z-RO50C	G7TC-ID16	Phillips screw	No
					XW2Z-RO50C	G70V-SID16P	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-C16	Push-In Plus	Yes
	XW2Z-RO50C	G70V-SID16P-1-C16	Push-In Plus		Yes			
	16 outputs	1 MIL connector (20)	PNP		XW2Z-RO50C	G7TC-OC16-1	Phillips screw	No
					XW2Z-RI100C	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RI100C	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RI100C	G70V-SOC16P-1-C4	Push-In Plus	Yes
XW2Z-RI100C				G70V-SOC16P-1-C4	Push-In Plus	Yes		
CJ1W-MD233	16 inputs	1 MIL connector (20)	NPN/ PNP	B	XW2Z-RO50C	G7TC-IA16	Phillips screw	No
					XW2Z-RO50C	G7TC-ID16	Phillips screw	No
					XW2Z-RO50C	G70V-SID16P	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-C16	Push-In Plus	Yes
	XW2Z-RO50C	G70V-SID16P-1-C16	Push-In Plus		Yes			
	16 outputs	1 MIL connector (20)	NPN		XW2Z-RO50C	G7TC-OC16	Phillips screw	No
					XW2Z-RO50C	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO50C	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO50C	G70V-SOC16P-C4	Push-In Plus	Yes
XW2Z-RO50C				G70V-SOC16P-C4	Push-In Plus	Yes		

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CJ1W-MD261	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	B	XW2Z-RI100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	NPN		XW2Z-RO100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75	G70V-SOC16P-C4	Push-In Plus	Yes
CJ1W-MD263	32 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-RO100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RO100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SID16P	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 MIL connector (40)	NPN		XW2Z-RO100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes

Note: 1. This Table of I/O Relay Terminal and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. The cable length of the XW2Z-RO50C is 0.5 m. Refer to the section from page 40 for details.

## For Omron PLC CS Series

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CS1W-ID231	32 inputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RI100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75	G70V-SID16P	Push-In Plus	No
			PNP		XW2Z-RI100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
CS1W-ID261	64 inputs	2 Fujitsu/Otax connectors (40)	NPN/ PNP	D	XW2Z-RI100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
CS1W-ID291	96 inputs	2 Fujitsu/Otax connectors (56)	NPN	E	XW2Z-R150C-125-100	G7TC-ID16	Phillips screw	No
					XW2Z-R150C-125-100	G7TC-IA16	Phillips screw	No
					XW2Z-R150C-125-100	G70V-SID16P	Push-In Plus	No
					XW2Z-R150C-125-100	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-R150C-125-100	G70V-SID16P-1	Push-In Plus	No
					XW2Z-R150C-125-100	G70V-SID16P-1-C16	Push-In Plus	Yes
CS1W-OD231	32 outputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RO100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-SOC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-FOM16	Phillips screw	No
					XW2Z-RO100C-75	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100C-75	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75	G70V-SOC16P-C4	Push-In Plus	Yes
CS1W-OD232	32 outputs	1 Fujitsu/Otax connector (40)	PNP	C	XW2Z-RO100C-75	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO100C-75	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100C-75	G70V-SOC16P-1-C4	Push-In Plus	Yes

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CS1W-OD261	64 outputs	2 Fujitsu/Otax connectors (40)	NPN	D	XW2Z-R0100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-SOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-FOM16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VSOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VFOM16	Phillips screw	No
					XW2Z-R0100C-75	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R0100C-75	G70V-SOC16P	Push-In Plus	No
XW2Z-R0100C-75	G70V-SOC16P-C4	Push-In Plus	Yes					
CS1W-OD262	64 outputs	2 Fujitsu/Otax connectors (40)	PNP	D	XW2Z-R0100-75-D1	G70D-SOC16-1	Phillips screw	No
					XW2Z-R0100C-75	G70A-ZOC16-4	Phillips screw	No
					XW2Z-R0100-75-D1	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-R0100-75-D1	G70V-SOC16P-1-C4	Push-In Plus	Yes
CS1W-OD291	96 outputs	2 Fujitsu/Otax connectors (56)	NPN	E	XW2Z-R150C-125-100	G7TC-OC16	Phillips screw	No
					XW2Z-R150C-125-100	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R150C-125-100	G70D-SOC16	Phillips screw	No
					XW2Z-R150C-125-100	G70D-FOM16	Phillips screw	No
					XW2Z-R150C-125-100	G70D-VSOC16	Phillips screw	No
					XW2Z-R150C-125-100	G70D-VFOM16	Phillips screw	No
					XW2Z-R150C-125-100	G70V-SOC16P	Push-In Plus	No
XW2Z-R150C-125-100	G70V-SOC16P-C4	Push-In Plus	Yes					
CS1W-OD292	96 outputs	2 Fujitsu/Otax connectors (56)	PNP	E	XW2Z-R0100C-75	G7TC-OC16-1	Phillips screw	No
CS1W-MD261	32 inputs	1 Fujitsu/Otax connector (40)	NPN/PNP	D	XW2Z-RI100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	NPN	D	XW2Z-R0100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-SOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-FOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VSOC16	Phillips screw	No
					XW2Z-R0100C-75	G70D-VFOM16	Phillips screw	No
					XW2Z-R0100C-75	G70D-ZOC16-3	Phillips screw	No
					XW2Z-R0100C-75	G70V-SOC16P	Push-In Plus	No
					XW2Z-R0100C-75	G70V-SOC16P-C4	Push-In Plus	Yes

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
CS1W-MD262	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	D	XW2Z-R100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-R100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-R100C-75	G70V-SID16P	Push-In Plus	No
					XW2Z-R100C-75	G70V-SID16P-1	Push-In Plus	No
					XW2Z-R100C-75	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-R100C-75	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	PNP		XW2Z-R0100C-75	G70A-SOC16-1	Phillips screw	No
					XW2Z-R0100C-75	G70A-ZOC16-4	Push-In Plus	No
					XW2Z-R0100C-75	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-R0100C-75	G70V-SOC16P-1-C4	Push-In Plus	Yes
CS1W-MD291	48 inputs	1 Fujitsu/Otax connector (56)	NPN/ PNP	E	XW2Z-R150C-125-100	G7TC-IA16	Phillips screw	No
					XW2Z-R150C-125-100	G7TC-ID16	Phillips screw	No
					XW2Z-R150C-125-100	G70V-SID16P	Push-In Plus	No
					XW2Z-R150C-125-100	G70V-SID16P-1	Push-In Plus	No
					XW2Z-R150C-125-100	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-R150C-125-100	G70V-SID16P-1-C16	Push-In Plus	Yes
	48 outputs	1 Fujitsu/Otax connector (56)	NPN		XW2Z-R150C-125-100	G7TC-OC16	Phillips screw	No
					XW2Z-R150C-125-100	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R150C-125-100	G70A-SOC16	Phillips screw	No
					XW2Z-R150C-125-100	G70A-FOM16	Phillips screw	No
					XW2Z-R150C-125-100	G70A-VSOC16	Phillips screw	No
					XW2Z-R150C-125-100	G70A-VFOM16	Phillips screw	No
					XW2Z-R150C-125-100	G70V-SOC16P	Push-In Plus	No
					XW2Z-R150C-125-100	G70V-SOC16P-C4	Push-In Plus	Yes
CS1W-MD292	48 inputs	1 Fujitsu/Otax connector (56)	NPN/ PNP	E	XW2Z-R150C-125-100	G7TC-IA16	Phillips screw	No
					XW2Z-R150C-125-100	G7TC-ID16	Phillips screw	No
					XW2Z-R150C-125-100	G70A-SID16P	Push-In Plus	No
					XW2Z-R150C-125-100	G70A-SID16P-1	Push-In Plus	Yes
					XW2Z-R150C-125-100	G70A-SID16P-C16	Push-In Plus	No
					XW2Z-R150C-125-100	G70A-SID16P-1-C16	Push-In Plus	Yes
	48 outputs	1 Fujitsu/Otax connector (56)	PNP		XW2Z-R150C-125-100	G7TC-OC16-1	Phillips screw	No

Note: 1. This Table of I/O Relay Terminal and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 40 for details.

## For Omron DeviceNet Slave

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
DRT2-ID16ML	16 inputs	1 MIL connector (20)	NPN	A	XW2Z-RI100C	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C	G70V-SID16P-C16	Push-In Plus	Yes
DRT2-ID16ML-1	16 inputs	1 MIL connector (20)	PNP	A	XW2Z-RO50C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-1-C16	Push-In Plus	Yes
DRT2-ID32ML	32 inputs	1 MIL connector (40)	NPN	C	XW2Z-RI100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RI100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RI100-75-D1	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
DRT2-ID32ML-1	32 inputs	1 MIL connector (40)	PNP	C	XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
DRT2-OD16ML	16 outputs	1 MIL connector (20)	NPN	A	XW2Z-RO50C	G7TC-OC16	Phillips screw	No
					XW2Z-RO50C	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO50C	G70D-SOC16	Phillips screw	No
					XW2Z-RO50C	G70D-FOM16	Phillips screw	No
					XW2Z-RO50C	G70D-VSOC16	Phillips screw	No
					XW2Z-RO50C	G70D-VFOM16	Phillips screw	No
					XW2Z-RO50C	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO50C	G70V-SOC16P-C4	Push-In Plus	Yes
DRT2-OD16ML-1	16 outputs	1 MIL connector (20)	PNP	A	XW2Z-RI100C	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO50C	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO50C	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO50C	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO50C	G70V-SOC16P-1-C4	Push-In Plus	Yes
DRT2-OD32ML	32 outputs	1 MIL connector (40)	NPN	C	XW2Z-RO100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-FOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
DRT2-OD32ML-1	32 outputs	1 MIL connector (40)	PNP	C	XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1-C4	Push-In Plus	Yes
DRT2-MD32ML	16 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-RM100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RM100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RM100-75-D1	G70V-SID16P	Push-In Plus	No
					XW2Z-RM100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
	16 outputs		XW2Z-RM100-75-D1		G7TC-OC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-ZOC16-3	Phillips screw	No	
			XW2Z-RM100-75-D1		G70D-SOC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70D-FOM16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70D-VSOC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70D-VFOM16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70V-SOC16P	Push-In Plus	No	
XW2Z-RM100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes					
DRT2-MD32ML-1	16 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
	16 outputs		XW2Z-RI100-75-D1		G7TC-OC16-1	Phillips screw	No	
			XW2Z-RO100-75-D1		G70A-ZOC16-4	Phillips screw	No	
			XW2Z-RO100-75-D1		G70D-SOC16-1	Phillips screw	No	
			XW2Z-RO100-75-D1		G70V-SOC16P-1	Push-In Plus	No	
			XW2Z-RO100-75-D1		G70V-SOC16P-1-C4	Push-In Plus	Yes	
DRT2-ID32B	32 inputs	1 MIL connector (40)	NPN	C	XW2Z-RI100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RI100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RI100-75-D1	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
DRT2-ID32B-1	32 inputs	1 MIL connector (40)	PNP	C	XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
DRT2-OD32B	32 outputs	1 MIL connector (40)	NPN	C	XW2Z-RO100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-FOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes
DRT2-OD32B-1	32 outputs	1 MIL connector (40)	PNP	C	XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1-C4	Push-In Plus	Yes

(Continued on the next page.)



PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
DRT2-MD32B	16 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-RM100C-75	G7TC-IA16	Phillips screw	No
					XW2Z-RM100C-75	G7TC-ID16	Phillips screw	No
					XW2Z-RM100-75-D1	G70V-SID16P	Push-In Plus	No
					XW2Z-RM100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
	16 outputs		XW2Z-RM100C-75		G70A-OC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-ZOC16-3	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-SOC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-FOM16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-VSOC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-VFOM16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70V-SOC16P	Push-In Plus	No	
			XW2Z-RM100-75-D1		G70V-SOC16P-C4	Push-In Plus	Yes	
DRT2-MD32B-1	16 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
					XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
	16 outputs		XW2Z-RO100-75-D1		G70A-SOC16-1	Phillips screw	No	
			XW2Z-RO100-75-D1		G70V-SOC16P-1	Push-In Plus	No	
			XW2Z-RO100-75-D1		G70V-SOC16P-1-C4	Push-In Plus	Yes	
			DRT2-ID32BV		32 inputs	1 MIL connector (40)	NPN	C
XW2Z-RI100-75-D1	G7TC-ID16	Phillips screw	No					
XW2Z-RI100-75-D1	G70V-SID16P	Push-In Plus	No					
XW2Z-RI100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes					
DRT2-ID32BV-1	32 inputs	1 MIL connector (40)	PNP	C	XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
XW2Z-RO100-75-D1					G70V-SID16P-1-C16	Push-In Plus	Yes	
DRT2-OD32BV	32 outputs	1 MIL connector (40)	NPN	C	XW2Z-RO100-75-D1	G7TC-OC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-FOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-C4	Push-In Plus	Yes
DRT2-OD32BV-1	32 outputs	1 MIL connector (40)	PNP	C	XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100-75-D1	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SOC16P-1-C4	Push-In Plus	Yes
DRT2-MD32BV	16 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-RM100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RM100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RM100-75-D1	G70V-SID16P	Push-In Plus	No
					XW2Z-RM100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
	16 outputs		XW2Z-RM100-75-D1		G70A-SOC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-FOM16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-VSOC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G7TC-OC16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70A-ZOC16-3	Phillips screw	No	
			XW2Z-RM100-75-D1		G70D-VFOM16	Phillips screw	No	
			XW2Z-RM100-75-D1		G70V-SOC16P	Push-In Plus	No	
			XW2Z-RM100-75-D1		G70V-SOC16P-C4	Push-In Plus	Yes	

(Continued on the next page.)

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
DRT2-MD32BV-1	16 inputs	1 MIL connector (40)	NPN/ PNP	B	XW2Z-RI100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RI100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RI100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
	16 outputs		PNP		XW2Z-RI100-75-D1	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100-75-D1	G70A-SOC16-1	Phillips screw	No
					XW2Z-RI100-75-D1	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RI100-75-D1	G70V-SOC16P-1-C4	Push-In Plus	Yes
GT1-ID16ML	16 inputs	1 Fujitsu/Otax connector (24)	NPN	A	XW2Z-RI100C	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C	G70V-SID16P-C16	Push-In Plus	Yes
GT1-ID16ML-1	16 inputs	1 Fujitsu/Otax connector (24)	PNP	A	XW2Z-RO50C	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO50C	G70V-SID16P-1-C16	Push-In Plus	Yes
GT1-ID32ML	32 inputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RI100-75-D1	G7TC-IA16	Phillips screw	No
					XW2Z-RI100-75-D1	G7TC-ID16	Phillips screw	No
					XW2Z-RI100-75-D1	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100-75-D1	G70V-SID16P-C16	Push-In Plus	Yes
GT1-ID32ML-1	32 inputs	1 Fujitsu/Otax connector (40)	PNP	C	XW2Z-RO100-75-D1	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RO100-75-D1	G70V-SID16P-1-C16	Push-In Plus	Yes
GT1-OD16ML	16 outputs	1 Fujitsu/Otax connector (24)	NPN	A	XW2Z-R100C	G7TC-OC16	Phillips screw	No
					XW2Z-R100C	G70A-ZOC16-3	Phillips screw	No
					XW2Z-R100C	G70D-SOC16	Phillips screw	No
					XW2Z-R100C	G70D-FOM16	Phillips screw	No
					XW2Z-R100C	G70D-VSOC16	Phillips screw	No
					XW2Z-R100C	G70D-VFOM16	Phillips screw	No
					XW2Z-R100C	G70V-SOC16P	Push-In Plus	No
					XW2Z-R100C	G70V-SOC16P-C4	Push-In Plus	Yes
GT1-OD16ML-1	16 outputs	1 Fujitsu/Otax connector (24)	PNP	A	XW2Z-R100C	G7TC-OC16-1	Phillips screw	No
					XW2Z-R100C	G70A-ZOC16-4	Phillips screw	No
					XW2Z-R100C	G70D-SOC16-1	Phillips screw	No
					XW2Z-R100C	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-R100C	G70V-SOC16P-1-C4	Push-In Plus	Yes
GT1-OD32ML	32 outputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RO100C-75	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75	G70D-SOC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-FOM16	Phillips screw	No
					XW2Z-RO100C-75	G70D-VSOC16	Phillips screw	No
					XW2Z-RO100C-75	G70D-VFOM16	Phillips screw	No
					XW2Z-RO100C-75	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75	G70V-SOC16P-C4	Push-In Plus	Yes
GT1-OD32ML-1	32 outputs	1 Fujitsu/Otax connector (40)	PNP	C	XW2Z-RO100C-75	G7TC-OC16-1	Phillips screw	No
					XW2Z-RO100C-75	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75	G70D-SOC16-1	Phillips screw	No
					XW2Z-RO100C-75	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100C-75	G70V-SOC16P-1-C4	Push-In Plus	Yes

Note: 1. This Table of I/O Relay Terminal and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. The cable length of the XW2Z-RO50C is 0.5 m. Refer to the section from page 40 for details.

## For Mitsubishi Electric PLC MELSEC L Series

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
LX41C4	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	C	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
LX42C4	64 inputs	2 Fujitsu/Otax connectors (40)	NPN/ PNP	D	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
LY41NT1P	32 outputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes
LY41PT1P	32 outputs	1 Fujitsu/Otax connector (40)	PNP	C	XW2Z-RO100C-75MN	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1-C4	Push-In Plus	Yes
LY42NT1P	64 outputs	2 Fujitsu/Otax connectors (40)	NPN	D	XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes
LY42PT1P	64 outputs	2 Fujitsu/Otax connectors (40)	PNP	D	XW2Z-RO100C-75MN	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1-C4	Push-In Plus	Yes
LH42C4NT 1P	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	D	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	NPN	D	XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes
LH42C4PT 1P	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	D	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	PNP	D	XW2Z-RO100C-75MN	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1	Push-In Plus	No
XW2Z-RO100C-75MN	G70V-SOC16P-1-C4	Push-In Plus	Yes					

Note: 1. This Table of I/O Relay Terminal and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 40 for details.

## For Mitsubishi Electric PLC MELSEC Q Series

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
QX41 QX41-S1 QX41-S2 QX71	32 inputs	1 Fujitsu/ Otax connector (40)	NPN/ PNP	C	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
QX42 QX42-S1 QX82 QX82-S1	64 inputs	2 Fujitsu/ Otax connectors (40)	NPN/ PNP	D	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
QY41P QY71	32 outputs	1 Fujitsu/ Otax connector (40)	NPN	C	XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes
QY42P	64 outputs	2 Fujitsu/ Otax connectors (40)	NPN	D	XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes
QY82P	64 outputs	2 Fujitsu/ Otax connectors (40)	PNP	D	XW2Z-RO100C-75MN	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1-C4	Push-In Plus	Yes
QH42P QX41Y41P	32 inputs	1 Fujitsu/ Otax connector (40)	NPN/ PNP	D	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 Fujitsu/ Otax connector (40)	NPN		XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes

Note: 1. This Table of I/O Relay Terminal and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 40 for details.

## For Mitsubishi Electric PLC MELSEC iQ-R Series

PLC I/O Unit				Connection pattern (page 20)	Connecting Cable *1	Connector-Terminal Block Conversion Unit		
Unit	I/O capacity	Number of connectors	Polarity			Model	Wiring method	Common terminal
RX41C4	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	C	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
RX42C4	64 inputs	2 Fujitsu/Otax connectors (40)	NPN/ PNP	D	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
RY41NT2P	32 outputs	1 Fujitsu/Otax connector (40)	NPN	C	XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes
RY41PT1P RY41PT2H	32 outputs	1 Fujitsu/Otax connector (40)	PNP	C	XW2Z-RO100C-75MN	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1-C4	Push-In Plus	Yes
RY42NT2P	64 outputs	2 Fujitsu/Otax connectors (40)	NPN	D	XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes
RY42PT1P	64 outputs	2 Fujitsu/Otax connectors (40)	PNP	D	XW2Z-RO100C-75MN	G70A-ZOC16-4	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-1-C4	Push-In Plus	Yes
RH42C4NT 2P	32 inputs	1 Fujitsu/Otax connector (40)	NPN/ PNP	D	XW2Z-RI100C-75MN	G7TC-ID16	Phillips screw	No
					XW2Z-RI100C-75MN	G7TC-IA16	Phillips screw	No
					XW2Z-RI100C-75MN	G70V-SID16P	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-C16	Push-In Plus	Yes
					XW2Z-RI100C-75MN	G70V-SID16P-1	Push-In Plus	No
					XW2Z-RI100C-75MN	G70V-SID16P-1-C16	Push-In Plus	Yes
	32 outputs	1 Fujitsu/Otax connector (40)	NPN		XW2Z-RO100C-75MN	G7TC-OC16	Phillips screw	No
					XW2Z-RO100C-75MN	G70A-ZOC16-3	Phillips screw	No
					XW2Z-RO100C-75MN	G70V-SOC16P	Push-In Plus	No
					XW2Z-RO100C-75MN	G70V-SOC16P-C4	Push-In Plus	Yes

Note: 1. This Table of I/O Relay Terminal and connectable device combinations mainly lists digital I/O units.

Note: 2. In the case of input/output mixed unit, the connection form pattern refers to the pattern diagram of the form that is connected to both input and output.

\*1. The cable model to use is one with a cable length of 1 m. Refer to the section from page 40 for details.


# Table of Connected Cables

Connecting Cables for Interface Wiring System XW2Z Series




## XW2Z-□□□A

Connector specifications	Model	Cable length L (m)	
		A	B
FCN 24-pin – MIL 20-pin	XW2Z-050A	0.5	
	XW2Z-100A	1	
	XW2Z-150A	1.5	
	XW2Z-200A	2	
	XW2Z-300A	3	
	XW2Z-500A	5	
	XW2Z-700A	7	
	XW2Z-010A	10	
	XW2Z-15MA	15	
	XW2Z-20MA	20	

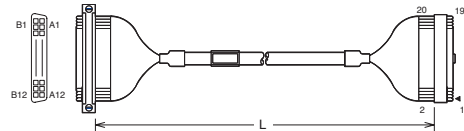


## XW2Z-□□□B

Connector specifications	Model	Cable length L (m)	
		A	B
FCN 40-pin – MIL 40-pin	XW2Z-050B	0.5	
	XW2Z-100B	1	
	XW2Z-150B	1.5	
	XW2Z-200B	2	
	XW2Z-300B	3	
	XW2Z-500B	5	
	XW2Z-700B	7	
	XW2Z-010B	10	
	XW2Z-15MB	15	
	XW2Z-20MB	20	

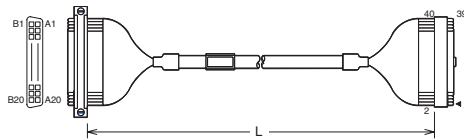


## XW2Z-□□□H-2

Connector specifications	Model	Cable length L (m)	
		A	B
FCN 56-pin – MIL 20-pin, MIL 40-pin	XW2Z-100H-2	1	0.75
	XW2Z-150H-2	1.5	1.25
	XW2Z-200H-2	2	1.75
	XW2Z-300H-2	3	2.75
	XW2Z-500H-2	5	4.75
	XW2Z-010H-2	10	9.75

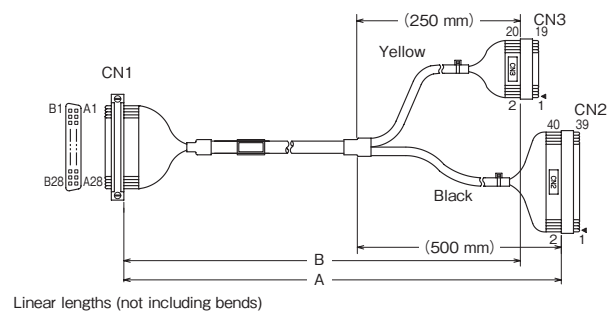

### XW2Z-□□□H-3


Connector specifications	Model	Cable length L (m)		
		A	B	C
FCN 56-pin – MIL 20-pin, MIL 20-pin, MIL 20-pin	XW2Z-100H-3	1	0.75	1
	XW2Z-150H-3	1.5	1.25	1.5
	XW2Z-200H-3	2	1.75	2
	XW2Z-300H-3	3	2.75	3
	XW2Z-500H-3	5	4.75	5
	XW2Z-010H-3	10	9.75	10

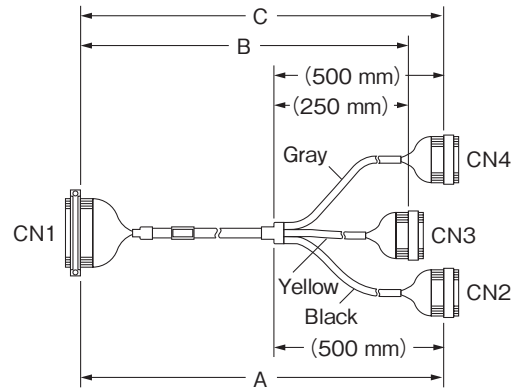

Linear lengths (not including bends)


### XW2Z-□□□K

Connector specifications	Model	Cable length L (m)
MIL 40-pin – MIL 40-pin	XW2Z-C25K	0.25
	XW2Z-C50K	0.5
	XW2Z-100K	1
	XW2Z-150K	1.5
	XW2Z-200K	2
	XW2Z-300K	3
	XW2Z-500K	5
	XW2Z-010K	10

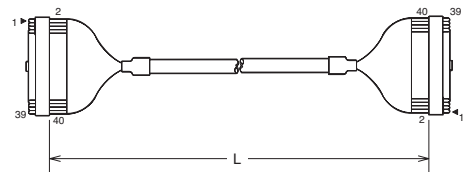

### XW2Z-□□□X

Connector specifications	Model	Cable length L (m)
MIL 20-pin – MIL 20-pin	XW2Z-C50X	0.5
	XW2Z-100X	1
	XW2Z-200X	2
	XW2Z-300X	3
	XW2Z-500X	5
	XW2Z-010X	10

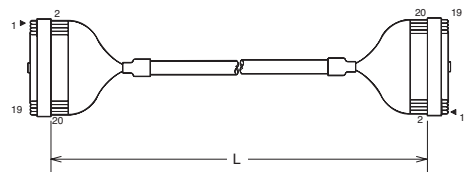


# Table of Connected Cables

Connecting Cables for I/O Relay Terminal XW2Z-R Series


## XW2Z-R□C

Connector specifications	Model	Cable length L (m)
FCN 24-pin – MIL 20-pin	XW2Z-R100C	1
	XW2Z-R150C	1.5
	XW2Z-R200C	2
	XW2Z-R300C	3
	XW2Z-R500C	5

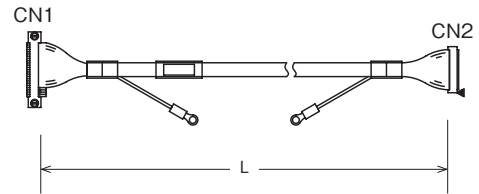


## XW2Z-RI□C-□、XW2Z-RO□C-□

Connector specifications	Model	Cable length L (m)	
		A	B
FCN 40-pin – MIL 20-pin, MIL 20-pin	XW2Z-RI100C-75	1	0.75
	XW2Z-RI150C-125	1.5	1.25
	XW2Z-RI200C-175	2	1.75
	XW2Z-RI300C-275	3	2.75
	XW2Z-RI500C-475	5	4.75
	XW2Z-RI1000C-975	10	9.75
	XW2Z-RO100C-75	1	0.75
	XW2Z-RO150C-125	1.5	1.25
	XW2Z-RO200C-175	2	1.75
	XW2Z-RO300C-275	3	2.75
	XW2Z-RO500C-475	5	4.75
	XW2Z-RO1000C-975	10	9.75

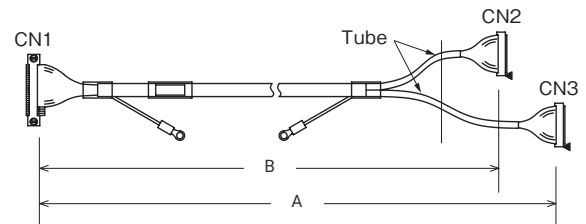


## XW2Z-R□C-□-□

Connector specifications	Model	Cable length L (m)		
		A	B	C
FCN 56-pin – MIL 20-pin, MIL 20-pin, MIL 20-pin	XW2Z-R150C-125-100	1.5	1.25	1
	XW2Z-R200C-175-150	2	1.75	1.5
	XW2Z-R300C-275-250	3	2.75	2.5

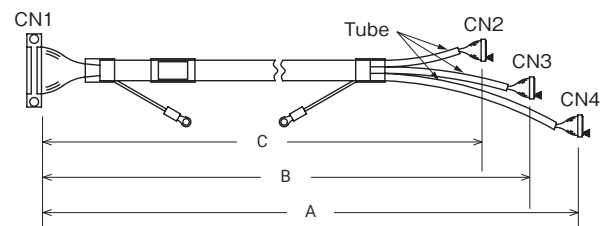

## XW2Z-RO□C、XW2Z-RI□C


Connector specifications	Model	Cable length L (m)
MIL 20-pin – MIL 20-pin	XW2Z-RO25C	0.25
	XW2Z-RO50C	0.5
	XW2Z-RI25C	0.25
	XW2Z-RI50C	0.5

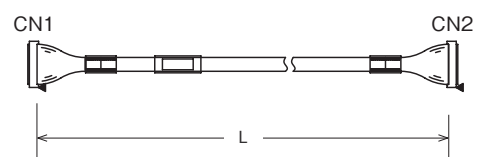




## XW2Z-RO□-□-D1、XW2Z-RI□-□-D1、XW2Z-RM□-□-D1

Connector specifications	Model	Cable length L (m)	
		A	B
FCN 40-pin – MIL 20-pin, MIL 20-pin	XW2Z-RO50-25-D1	0.5	0.25
	XW2Z-RO75-50-D1	0.75	0.5
	XW2Z-RO100-75-D1	1	0.75
	XW2Z-RO150-125-D1	1.5	1.25
	XW2Z-RO200-175-D1	2	1.75
	XW2Z-RO300-275-D1	3	2.75
	XW2Z-RO500-475-D1	5	4.75
	XW2Z-RI50-25-D1	0.5	0.25
	XW2Z-RI75-50-D1	0.75	0.5
	XW2Z-RI100-75-D1	1	0.75
	XW2Z-RI150-125-D1	1.5	1.25
	XW2Z-RI200-175-D1	2	1.75
	XW2Z-RI300-275-D1	3	2.75
	XW2Z-RI500-475-D1	5	4.75
	XW2Z-RM50-25-D1	0.5	0.25
	XW2Z-RM75-50-D1	0.75	0.5
	XW2Z-RM100-75-D1	1	0.75
	XW2Z-RM150-125-D1	1.5	1.25
	XW2Z-RM200-175-D1	2	1.75
	XW2Z-RM300-275-D1	3	2.75
XW2Z-RM500-475-D1	5	4.75	

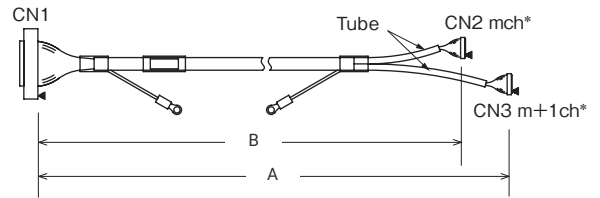

## XW2Z-RI□C-□-MN、XW2Z-RO□C-□-MN (For connecting PLC manufactured by Mitsubishi Electric)

Connector specifications	Model	Cable length L (m)	
		A	B
FCN 40-pin – MIL 20-pin, MIL 20-pin	XW2Z-RI100C-75-MN	1	0.75
	XW2Z-RI150C-125-MN	1.5	1.25
	XW2Z-RI200C-175-MN	2	1.75
	XW2Z-RI300C-275-MN	3	2.75
	XW2Z-RI500C-475-MN	5	4.75
	XW2Z-RI1000C-975-MN	10	9.75
	XW2Z-RO100C-75-MN	1	0.75
	XW2Z-RO150C-125-MN	1.5	1.25
	XW2Z-RO200C-175-MN	2	1.75
	XW2Z-RO300C-275-MN	3	2.75
	XW2Z-RO500C-475-MN	5	4.75
	XW2Z-RO1000C-975-MN	10	9.75

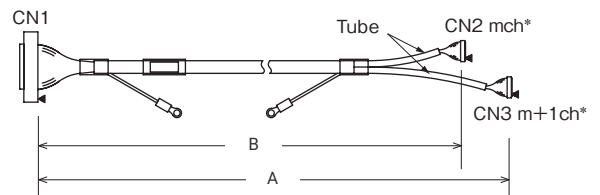

# Terms and Conditions Agreement

## Read and understand this catalog.

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

## Warranties.

- (a) Exclusive Warranty. Omron's exclusive warranty is that the Products will be free from defects in materials and workmanship for a period of twelve months from the date of sale by Omron (or such other period expressed in writing by Omron). Omron disclaims all other warranties, express or implied.
- (b) Limitations. OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, ABOUT NON-INFRINGEMENT, MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OF THE PRODUCTS. BUYER ACKNOWLEDGES THAT IT ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE.

Omron further disclaims all warranties and responsibility of any type for claims or expenses based on infringement by the Products or otherwise of any intellectual property right. (c) Buyer Remedy. Omron's sole obligation hereunder shall be, at Omron's election, to (i) replace (in the form originally shipped with Buyer responsible for labor charges for removal or replacement thereof) the non-complying Product, (ii) repair the non-complying Product, or (iii) repay or credit Buyer an amount equal to the purchase price of the non-complying Product; provided that in no event shall Omron be responsible for warranty, repair, indemnity or any other claims or expenses regarding the Products unless Omron's analysis confirms that the Products were properly handled, stored, installed and maintained and not subject to contamination, abuse, misuse or inappropriate modification. Return of any Products by Buyer must be approved in writing by Omron before shipment. Omron Companies shall not be liable for the suitability or unsuitability or the results from the use of Products in combination with any electrical or electronic components, circuits, system assemblies or any other materials or substances or environments. Any advice, recommendations or information given orally or in writing, are not to be construed as an amendment or addition to the above warranty.

See <http://www.omron.com/global/> or contact your Omron representative for published information.

## Limitation on Liability: Etc.

OMRON COMPANIES SHALL NOT BE LIABLE FOR SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR PRODUCTION OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED IN CONTRACT, WARRANTY, NEGLIGENCE OR STRICT LIABILITY.

Further, in no event shall liability of Omron Companies exceed the individual price of the Product on which liability is asserted.

## Suitability of Use.

Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

## Programmable Products.

Omron Companies shall not be responsible for the user's programming of a programmable Product, or any consequence thereof.

## Performance Data.

Data presented in Omron Company websites, catalogs and other materials is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of Omron's test conditions, and the user must correlate it to actual application requirements. Actual performance is subject to the Omron's Warranty and Limitations of Liability.

## Change in Specifications.

Product specifications and accessories may be changed at any time based on improvements and other reasons. It is our practice to change part numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the Product may be changed without any notice. When in doubt, special part numbers may be assigned to fix or establish key specifications for your application. Please consult with your Omron's representative at any time to confirm actual specifications of purchased Product.

## Errors and Omissions.

Information presented by Omron Companies has been checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical or proofreading errors or omissions.

**Note: Do not use this document to operate the Unit.**

## **OMRON Corporation Industrial Automation Company**

**Kyoto, JAPAN**

**Contact : [www.ia.omron.com](http://www.ia.omron.com)**

### **Regional Headquarters**

#### **OMRON EUROPE B.V.**

Wegalaan 67-69, 2132 JD Hoofddorp  
The Netherlands  
Tel: (31) 2356-81-300 Fax: (31) 2356-81-388

#### **OMRON ELECTRONICS LLC**

2895 Greenspoint Parkway, Suite 200  
Hoffman Estates, IL 60169 U.S.A.  
Tel: (1) 847-843-7900 Fax: (1) 847-843-7787

#### **OMRON ASIA PACIFIC PTE. LTD.**

438B Alexandra Road, #08-01/02 Alexandra  
Technopark, Singapore 119968  
Tel: (65) 6835-3011 Fax: (65) 6835-3011

#### **OMRON (CHINA) CO., LTD.**

Room 2211, Bank of China Tower,  
200 Yin Cheng Zhong Road,  
PuDong New Area, Shanghai, 200120, China  
Tel: (86) 21-6023-0333 Fax: (86) 21-5037-2388

**Authorized Distributor:**

©OMRON Corporation 2022-2024 All Rights Reserved.  
In the interest of product improvement,  
specifications are subject to change without notice.

**CSM\_3\_1**

**Cat. No. G154-E1-03 0424 (0922)**