



Type G9SX-NSA222-T03-□ Type G9SX-NS202-□

Non-contact Door Switch Controller

English USER'S MANUAL

Thank you for purchasing G9SX-NS□ Non-contact Door Switch Controller.

Please read and understand this manual before using the products.

Keep this manual ready to use whenever needed. Only qualified person trained in professional electrical technique should handle G9SX-NS□.

Please consult your OMRON representative if you have any questions or comments. Make sure that information written in this document are delivered to the final user of the product.

OMRON Corporation

© OMRON Corporation 2006-2020 All Rights Reserved. 0631752-3 J

EU Declaration of Conformity

OMRON declares that G9SX-NS□ is in conformity with the requirements of the following EU Directives:

- Machinery Directive 2006/42/EC
- EMC Directive 2014/30/EU

Standards

G9SX-NS□ is designed and manufactured in accordance with the following standards:

- EN ISO13849-1:2015
- Cat. 3 PL d (with D40A) / Cat. 4 PL e (with D40Z)
- IEC/EN61508 SIL3,
- IEC/EN61000-6-2, - IEC/EN61000-6-4,
- UL508, - UL1998,
- CAN/CSA C22.2 No.142

Safety Precautions

Meanings of Signal Words

The following signal words are used in this manual.



Indicates a potentially hazardous situation which, if not avoided, will result in minor or moderate injury, or may result in serious injury or death. Additionally there may be significant property damage.

Meaning of Alert Symbols

The following alert symbols are used in this manual.



Indicates prohibited actions.



Indicates mandatory actions.

Alert Statements



Serious injury may possibly occur due to breakdown of safety outputs. Do not connect loads beyond the rated value to the safety outputs.

Serious injury may possibly occur due to loss of required safety functions. Wire G9SX-NS□ properly so that supply voltages or voltages for loads do NOT touch the safety inputs accidentally or unintentionally.

Serious injury may possibly occur due to damages of safety inputs. Apply protection circuitry against back electromotive force in case connecting inductive loads to safety outputs.

Serious injury may possibly occur due to loss of safety functions. Use appropriate devices referring to the information provided below.

Controlling Devices	Requirements
Emergency stop switch	Use approved devices with Direct Opening Mechanism complying with IEC/EN 60947-5-1
Door interlocking switch	Use approved devices with Direct Opening Mechanism complying with IEC/EN 60947-5-1 and capable of switching micro loads of 24VDC, 5mA.
Limit switch	
Non-contact Door Switch	G9SX-NS□ must be used with Non-contact Door Switch Type D40A/D40Z series.
Relay with forcibly guided contacts	Use approved devices with forcibly guided contacts complying with EN 50205. For feedback purpose use devices with contacts capable of switching micro loads of 24VDC, 5mA.
Contactors	Use a standard certified product that meets the requirements for the auxiliary contact (mirror contact) linked to the main contact of IEC/EN60947-4-1. Use feedback contacts that can be applied to minute loads (24 VDC, 5 mA).
Other devices	Evaluate whether devices used are appropriate to satisfy the requirements of safety category level.


Precautions for Safe Use

- Use G9SX-NS□ within an enclosure with IP54 protection or higher according to IEC/EN60529
- Incorrect wiring may lead to loss of safety function. Wire conductors correctly and verify the operation of G9SX-NS□ before using the system in which G9SX-NS□ is incorporated.
- Do not apply DC voltages exceeding the rated voltages, nor any AC voltages to G9SX-NS□. Do not connect to DC distribution network.
- Use DC supply satisfying requirements below to prevent electric shock.
 - DC power supply with double or reinforced insulation, for example, according to IEC/EN60950 or EN50178 or a transformer according to IEC/EN61558.
 - DC supply satisfies the requirement for class 2 circuits or limited voltage/current circuit stated in UL 508.
- Apply properly specified voltages to G9SX-NS□ inputs. Applying inappropriate voltages cause G9SX-NS□ to fail to perform its specified function, which leads to the loss of safety functions or damages to G9SX-NS□.
- Auxiliary error outputs and auxiliary monitoring outputs are NOT safety outputs. Do not use auxiliary outputs as any safety output. Such incorrect use causes loss of safety function of G9SX-NS□ and its relevant system. Also Logical connection outputs can only be used for logical connections between G9SXs.
- After installation of G9SX-NS□, qualified personnel should confirm the installation, and should conduct test operations and maintenance. The qualified personnel should be qualified and authorized to secure the safety on each phases of design, installation, running, maintenance and disposal of system.
- A person in charge, who is familiar to the machine in which G9SX-NS□ is to be installed, should conduct and verify the installation.
- Perform daily and 6-month inspections for the G9SX-NS□. Otherwise, the system may fail to work properly, resulting in serious injury.
- Do not dismantle, repair, or modify G9SX-NS□. It may lead to loss of its safety functions.
- Use only appropriate components or devices complying with relevant safety standards corresponding to the required level of safety categories. Conformity to requirements of safety category is determined as an entire system. It is recommended to consult a certification body regarding assessment of conformity to the required safety level.
- OMRON shall not be responsible for conformity with any safety standards regarding to customer's entire system.
- Disconnect G9SX-NS□ from power supply when wiring. Devices connected to G9SX-NS□ may operate unexpectedly.

- Be cautious not to have your fingers caught when attaching terminal sockets to the plugs on G9SX-NS□.
- Do not operate the D40A/D40Z with flammable or explosive gas.

Precautions for Correct Use

- Connection with Non-contact Door Switch
Wire conductors between G9SX-NS□ and Non-contact Door Switch D40A/D40Z correctly and verify the operation, before committing the system.
- Handle with care
Do not drop G9SX-NS□ to the ground or expose to excessive vibration or mechanical shocks. G9SX-NS□ may be damaged and may not function properly.
- Conditions of storage and usage
Do not store or use in such conditions stated below.
 - In direct sunlight
 - At ambient temperatures out of the range of -10 to 55 °C
 - At relative humidity out of the range of 25 to 85% or under such temperature change that causes condensation.
 - In corrosive or combustible gases
 - With vibration or mechanical shocks out of the rated values.
 - Under splashing of water, oil, chemicals
 - In the atmosphere containing dust, saline or metal powder. G9SX-NS□ may be damaged and may not function properly.
- Mounting
Mount G9SX-NS□ to DIN rails with attachments (TYPE PFP-M, not incorporated in this product), not to drop out of rails by vibration etc. especially when the length of DIN railing is short compared to the widths of G9SX-NS□.
- Following spacing around G9SX-NS□ should be available to apply rated current to outputs of G9SX-NS□ and for enough ventilation and wiring:

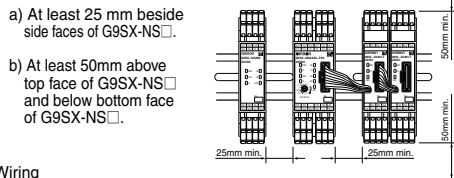


- Wiring
 - For model G9SX-NS□
Use the following to wire to G9SX-NS□.
-Solid wire: 0.2 to 2.5mm² AWG24 to AWG12
-Stranded wire (Flexible wire): 0.2 to 2.5mm² AWG24 to AWG12
Strip the cover of wire no longer than 7mm.
 - For model G9SX-NS□-RT (with screw terminals)
Tighten each screw with a specified torque of 0.5 to 0.6N·m, or the G9SX-NS□ may malfunction or generate heat.
 - For Logical AND Connection
Use VCTF cable or shielded cable for Logical AND connection between units.
 - For Non-contact Door Switch D40A/D40Z
When you use an additional cable of 20m or longer, use a multiconductor cable to group the white, black, brown, and blue lines together.

- When connecting Expansion Units (G9SX-EX□-□) to G9SX-NSA222-T03-□:
 - Follow the procedure below:
 - Remove the termination connector from the receptacle on G9SX-NSA222-T03-□.
 - Insert the head of the connecting cable of Expansion Unit to the receptacle on the G9SX-NSA222-T03-□
 - Set the termination connector to the receptacle on the Expansion Unit at the end position. When G9SX-NSA222-T03-□ is used without expansion units, leave the termination connector set on the G9SX-NSA222-T03-□.
 - Do not remove the termination connector while the system is operating.
 - Before applying supply voltage, confirm that the connecting sockets and plugs are locked firmly.
 - All of the Expansion Units should be supplied with its specified voltages within 10s after the connected G9SX-NSA222-T03-□ is supplied with voltage. Otherwise, G9SX-NSA222-T03-□ detects the power-supply error for the Expansion Units.


- Use cables with length 100m or less to connect to Safety Inputs, Non-contact Door switch input, Feed-back/Reset inputs, or between Logical AND connection inputs and Logical connection outputs, respectively.
- Set the time duration of OFF-delay to an appropriate value that does not cause the loss of safety function of system.
- Logical connection between Units:
 - When using Logical AND connection inputs, set the Logical connection preset switch to 'AND' position for the units which the logical connection signal are input to.
 - Connect Logical connection outputs appropriately to Logical AND connection inputs of the relevant unit. Verify the operation of G9SX-NS□ before commissioning the system.
 - When configuring the safety related system, be sure to consider that the delay of response time caused by logical connections do not degrade the safety function of the system.
- To determine safety distance to hazards, take into account the delay of Safety outputs caused by the following time:
 - Response time of Safety inputs
 - Response time of Non-contact door switch (D40A/D40Z) inputs
 - Response time of Logical AND connection input (See also "Ratings and specifications, note5")
 - Preset off-delay time
 - Accuracy of off-delay time
- Start entire system after more than 5s have passed since applying supply voltage to all G9SXs in the system.
- G9SX-NS□ may malfunction due to electro-magnetic disturbances. Be sure to connect the terminal A2 to ground. When using a DC power supply with light curtains, use DC power supply which has no interruption by a power failure of 20ms.
- Devices connected to G9SX-NS□ may operate unexpectedly. When replacing G9SX-NS□, disconnect it from power supply.
- Adhesion of solvent such as alcohol, thinner, trichloroethane or gasoline on the product should be avoided. Such solvents make the marking on G9SX-NS□ illegible and cause deterioration of parts.
- Operate the reset input more than 0.4 seconds immediately after the safety outputs are OFF. G9SX does not accept the reset input when the outputs are turned ON and until 0.4 seconds passes after the outputs are turned OFF.
- This is a class A product. In residential areas it may cause radio interference, in which case the user may be required to take

1 Appearance and Explanation of Each Parts

Type G9SX-NSA222-T03-□

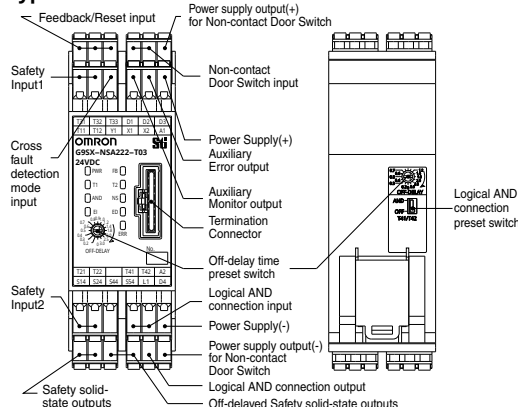

Type G9SX-NS202-□

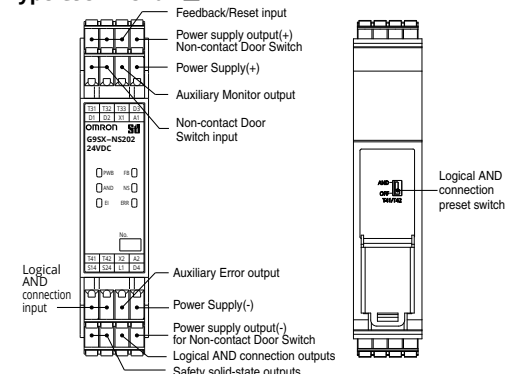

Settings indication (at power on)


Settings for G9SX-NS□ can be checked by indicators for approx. 3 seconds after power on. During the settings indication time, ERR indicator will light up, however the auxiliary error output will remain off.

Indicator	Items	Setting position	indicator status	Setting mode	Setting status
T1	Cross fault detection mode (Type G9SX-NSA222-T03-□)	Y1 terminal	light up	detection mode	Y1 = open
			not lit	non-detection mode	Y1 = 24VDC
FB	Reset mode	T32 or T33 terminal	light up	manual reset mode	T33 = 24VDC
			not lit	auto reset mode	T32 = 24VDC
AND	Logical AND connection input mode	Logical AND connection preset switch	light up	enable Logical AND input	'AND'
			not lit	disable Logical AND input	'OFF'

LED Indicators


Marking	Color	Name	Function
PWR	Green	Power Supply Indicator	- Lights up while power is supplied.
ERR	Red	Error Indicator	- Lights up or blinks corresponding to the occurring error (*1)
T1	Orange	Safety input #1 Indicator	- Lights up while high signal is input to T12 - Blinks when error relating to Safety input #1 occurs. (*1)
		Safety input #2 Indicator	- Lights up while high signal is input to T22 - Blinks when error relating to Safety input #2 occurs. (*1)
AND	Orange	Logical AND Input Indicator	- Lights up while high signal is input to T41. - Blinks when error relating to Logical AND connection input occurs. (*1)
NS	Orange	Non-Contact Door Switch input	- Lights up while high signal is input to D2. - Blinks when error relating to Non-contact Door Switch input occurs. (*1)
FB	Orange	Feedback/Reset input Indicator	- Lights up in the following cases: -- With automatic reset while high signal is input to T33 -- With manual reset while high signal is input to T32. - Blinks when an error relating to Feedback/Reset input occurs. (*1)
		Safety output indicator	- Lights up while Safety solid-state outputs (S14, S24) are in ON-state. - Blinks when an error relating to Safety solid-state output occurs. (*1)
EI	Orange	Safety output indicator	- Lights up while Safety off-delayed solid-state outputs (S44, S54) are in ON-state. - Blinks when an error relating to Safety off-delayed solid-state output occurs. (*1)
ED	Orange	Off-delayed Safety output Indicator	- Lights up while Safety off-delayed solid-state outputs (S44, S54) are in ON-state. - Blinks when an error relating to Safety off-delayed solid-state output occurs. (*1)

2 Internal Connection

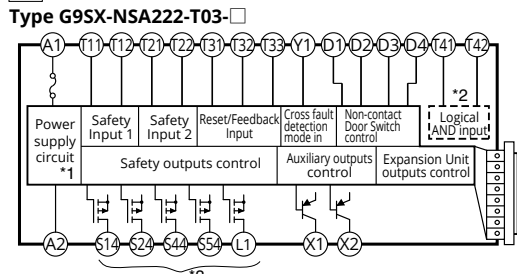

- *1 Internal power supply circuit is not isolated.
- *2 Logical AND input is isolated.
- *3 The Safety solid-state outputs, S14-S54, are internally redundant, respectively.

Type G9SX-NS202-□

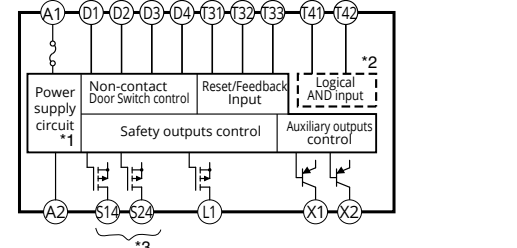

- *1 Internal power supply circuit is not isolated.
- *2 Logical AND input is isolated.
- *3 The Safety solid-state outputs, S14 and S24, are internally redundant, respectively.

4 Ratings and Specifications

Ratings

Item	TYPE G9SX-NSA222-T03-□	TYPE G9SX-NS202-□
Power input	Rated supply voltage 24VDC Operating voltage range -15% to +10% of rated supply voltage Rated power consumption (See Note1) 4 W Max.	24VDC -15% to +10% of rated supply voltage 3 W Max.
Inputs	Emergency stop input Feedback/reset input	Operating Voltage: 20.4VDC to 26.4VDC. Internal impedance : approx. 2.8kohm (See Note2)
Outputs	Safety solid-state output (See Note3) Off-delayed safety solid-state output (See Note3) Auxiliary output	P channel MOS FET output Load current: 0.8A DC Max.(See Note4,5) PNP transistor output Load current: 100mA Max.


Specifications and Performance

Item	TYPE G9SX-NSA222-T03-□	TYPE G9SX-NS202-□
Over voltage category (IEC/EN 60664-1)	II	-
Operating time (OFF to ON state)(See Note6,7)	Safety input	50ms Max.
	Logical AND connection input	100ms Max.
	Non-contact door switch input	100ms Max.
Response time (ON to OFF state) (See Note6)	Safety input	15 ms Max.
	Logical AND connection input	15 ms Max.
	Non-contact door switch input	20 ms Max. (See note8)
ON-state residual voltage	3.0 V Max.	-
OFF-state Leakage current	0.1 mA Max.	-
Maximum cable length for Logical connection input, Safety inputs and Non-contact Door Switch input	100m Max. (Permissible impedance of inputs : 100ohm Max and 10nF Max)	-
Number of units connected per one Logical connection output.	4 units Max. (See Note9)	-
Total number of units connected with Logical connection	20 units Max. (See Note9,10)	-
Number of units connected in series with Logical connection	5 units Max. (See Note9)	-
Total number of non-contact door switches	30 switches Max.	-
Accuracy of Off-delay time	Within plus or minus 5% of the set value	-
Reset input time	100ms Min.	-
Vibration resistance	Frequency: 10 to 55 to 10Hz, Amplitude: 0.375mm half amplitude (0.75mm double amplitude)	-
Mechanical shock resistance	300 m/s ² (destruction), 100 m/s ² (malfunction)	-
Ambient temperature	-10 to +55 °C (No freezing or condensation)	-
Ambient humidity	25 to 85 %RH	-
Pollution degree	2	-
Terminal tightening torque	0.5Nm (Applicable only to TYPE G9SX-NS□-RT: screw terminal model)	-
Weight	Approx. 200g	Approx. 125 g


Insulation specifications

Item	TYPE G9SX-NSA222-T03-□ / G9SX-NS202-□
Insulation resistance	- Between Logical AND connection terminals, and Power supply input terminals and other input and output terminals connected together. 20Mohm Min. (by 100VDC megger)
	- Between all terminals connected together and DIN rail. 20Mohm Min. (by 100VDC megger)
Dielectric strength	- Between Logical AND connection terminals, and Power supply input terminals and other input and output terminals connected together. 500VAC for 1min
	- Between all terminals connected together and DIN rail. 500VAC for 1min

- Power consumption of loads and non-contact door switches is not included.
- Ensure that the current exceeds the minimum applicable load of the device connected.
- While safety outputs are at its ON state, signal sequence shown below is output continuously for diagnosis. When using the safety outputs as input signals to control devices (e.i. programmable controller), consider the off pulse below.



- The following derating is required when Units are mounted side-by-side. G9SX-NSA222-T03-□/G9SX-NS202-□: 0.4 A max. load current
- The following derating is required when inductive load is connected to safety outputs.
 - IEC/EN60947-5-1 DC-13: 0.8A
 - UL508 Pilot Duty: 0.5A
- When multiple units are connected by logical connection, the total operating/response time is an accumulation of the operating/response time connected.
- Required time for safety solid-state output to turn ON, after necessary inputs turn ON.
- Risk time: Fault detection time for a short circuit between Non-contact Door Switch input and 24VDC is 35ms Max. For other applications, different to door switches, it shall be necessary to calculate the safety distance with the fault detection time 35ms max.
- For details of the system with logical connection refer to the illustration below.

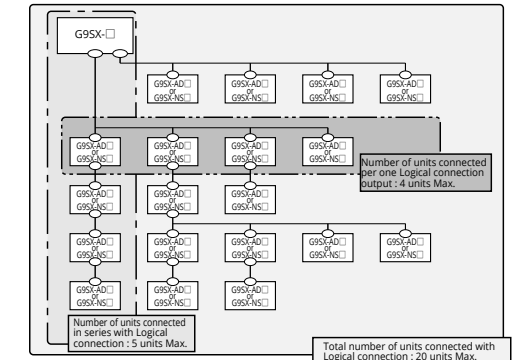


Preset Switches

Change the value of the preset switches only when G9SX-NS□ is disconnected from power supply. The states of the preset switches come into effect when the power supply to G9SX-NS□ turns on.


Name	Function	State/Value (position of switch)
Logical AND Connection	Sets Logical AND Connection Inputs to valid or invalid. (*2)	OFF (Invalid: default setting)/ AND (valid)
Preset Switch	Presets Off-delay time (duplicate) (*3), (*4)	0 (default setting value) /0.2/0.3/0.4/0.5/0.6/0.7/0.8/0.9/1.0 /1.2/1.4/1.8/2.0/2.5/3.0 (s) (*5)

- Note:
(*1) See ' [7] Fault Detection' for details.
(*2) When operating G9SX-NS□ using Logical AND Connection function, be sure to set the preset switch to AND (valid) position for the units which the logical input signal is input to. When the switch is set to OFF (invalid) position, it is detected as a fault.
(*3) Set both of the two Off-delay Time Preset Switches, one each on the front and back, to the same value.
(*4) Off-delay time duration of Expansion Unit (OFF-delay model) synchronize with the OFF-delay time duration set by Off-delay Time Preset Switch of G9SX-NSA222-T03-□.
(*5) See following illustration for setting position of Off-delay Time Preset Switch. Make sure that the direction of cutting edge of preset switch is correctly pointed to the off-delay time value which must be set.

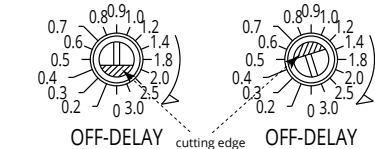

3 Dimensions

Type G9SX-NSA222-T03-□ Type G9SX-NS202-□

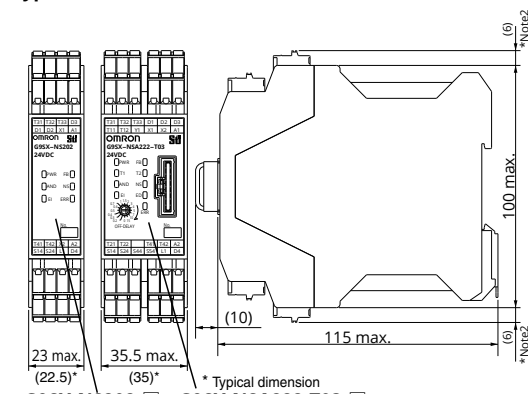

- * Note1 Above outline drawing is for -RC terminal type.
- * Note2 For -RC terminal type only.

Suitability for Use

Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.


5 Examples of application

Application and timing chart

G9SX-NSA222-T03 (24VDC)

(2-channel emergency stop switch input + non-contact door switch input / Manual reset)


Note1: This example is corresponding to category 4 (ISO13849-1)
 Note2: For details of wiring around the non-contact door switch, refer to the D40Z's manual.

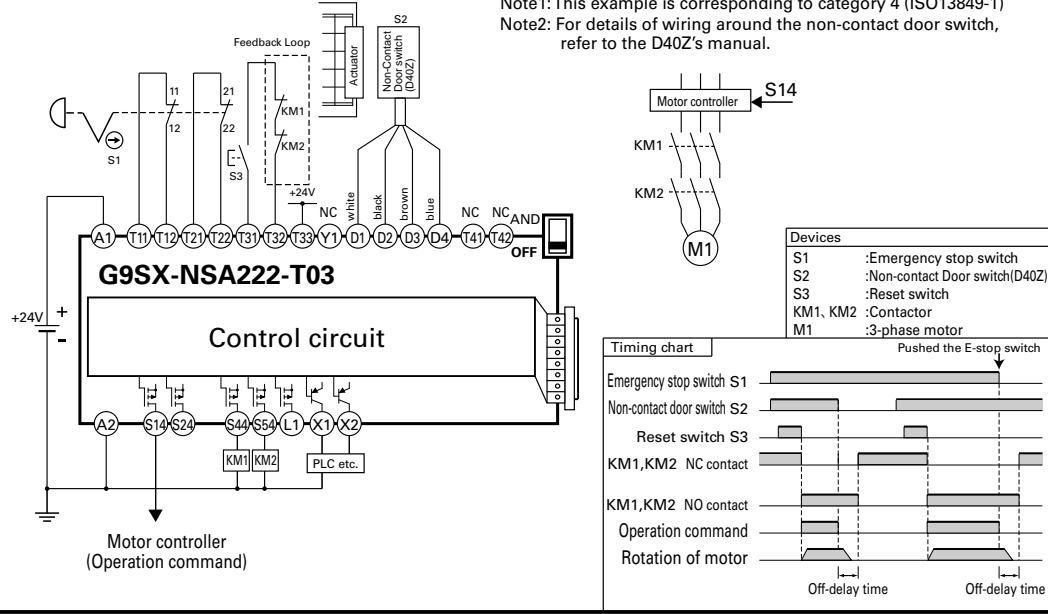

G9SX-NSA222-T03 (24VDC)


(2-channel safety limit switch input + non-contact door switch input / Auto reset)

Note1: This example is corresponding to category 3 (ISO13849-1)
 Note2: For details of wiring around the non-contact door switch, refer to the D40A's manual.

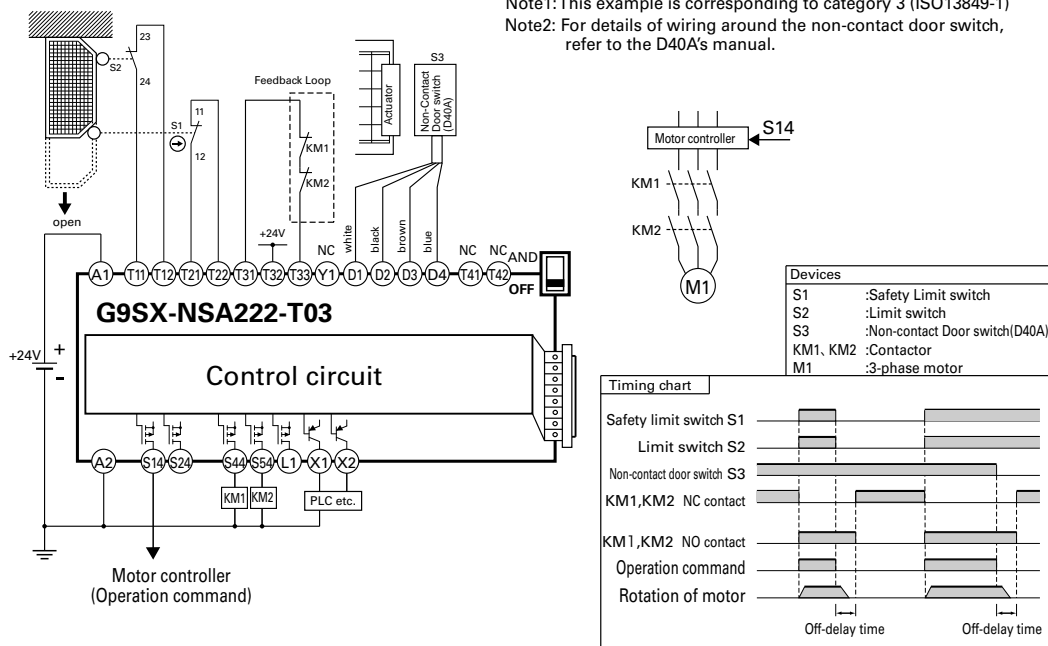

G9SX-BC202(DC24V) (2-channel emergency stop switch input / Manual reset) + G9SX-NS202(DC24V) (Non-contact door switch input / Auto reset)

Note1: This example is corresponding to category 3 (ISO13849-1)
 Note2: For details of wiring around the non-contact door switch, refer to the D40A's manual.

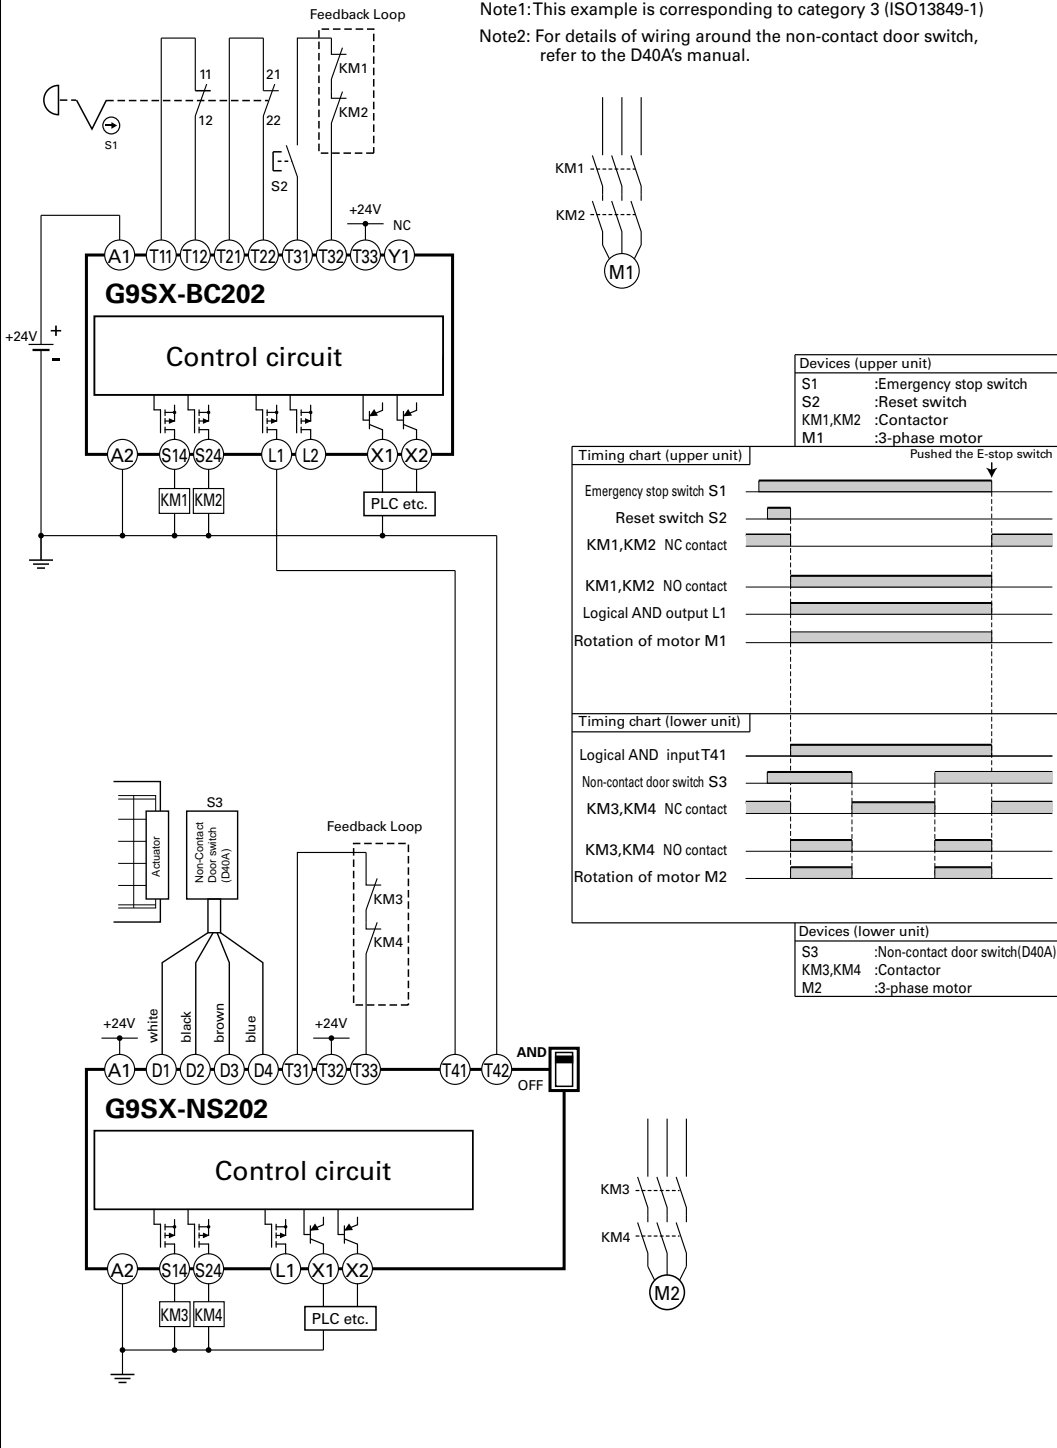

Wiring of inputs and outputs



Signal Name	Terminal Name	Description of operation	Wiring
Power supply input	A1, A2	Connect the power source to the A1 and A2 terminals.	Connect the power supply plus to the A1 terminal. Connect the power supply minus to the A2 terminal.
Safety input 1	T11, T12	To set Safety solid-state outputs in ON state, HIGH state signals must be input to both of Safety input 1 and Safety input 2. Otherwise Safety solid-state outputs cannot be in ON state.	Using safety input 1 system Using safety input 2 system (without short-circuit monitoring between systems) Using safety input 2 system (with short-circuit monitoring between systems)
Safety input 2	T21, T22		
Feedback/Reset input	T31, T32, T33	To set Safety solid-state outputs in ON state, ON state signal must be input to T33. Otherwise Safety solid-state outputs cannot be in ON state. To set Safety solid-state outputs in ON state, the signal input to T32 must change from OFF state to ON state, and then to OFF state. Otherwise Safety solid-state outputs cannot be in ON state.	Auto reset Manual reset
Logical AND connection input	T41, T42	Logical AND connection means that lower unit (Unit B) calculates the logical multiplication (AND) of the safety output information from upper unit (Unit A) and safety input signal "b", which is input to lower unit. In the example of a right picture, the safety output of Unit C is "a" AND "b". Connect L1 or L2 of upper unit to T41 of lower unit, and connect GND of upper unit to T42 of lower unit. To set Safety solid-state outputs of the subsequent Unit in ON state, its Logical AND Connection Preset Switch must be set to AND (enable) and High state signal must be input to T41 of the subsequent unit.	Diagram showing logical AND connection between two units.
Cross fault detection input	Y1	Selects a mode of failure detecting (Cross fault detecting) function for safety inputs of G9SX-NSA222-T03-□ corresponding to the connection of Cross fault detection input.	Keep Y1 open when using T11, T21. (Cross fault detecting mode) Connect Y1 to 24VDC when NOT using T11, T21. (Wiring corresponding category 2 or 3)
Safety solid-state output	S14, S24	Turns ON/OFF according to the state of safety inputs, Feedback/Reset inputs, and Logical AND connection inputs. During off-delay state, safety solid-state outputs are not able to turn ON.	Keep these outputs Open when NOT used.
Off-delayed Safety solid-state output	S44, S54	Off-delayed safety solid-state outputs. Off-delay time is set by off-delay preset switch. When the delay time is set to zero, these outputs can be used as non-delay outputs.	Keep these outputs Open when NOT used.
Logical connection output	L1	Outputs a signal of the same logic as Safety solid-state outputs.	Keep these outputs Open when NOT used.
Non-contact Door Switch input	D1, D2, D3, D4	To set Safety solid-state outputs in ON state, all non-contact door switch must be ON state. Otherwise Safety solid-state outputs cannot be in ON state.	Diagram showing non-contact door switch wiring.
Auxiliary Monitor output	X1	Outputs a signal of the same logic as Safety solid-state outputs	Keep these outputs Open when NOT used.
Auxiliary Error output	X2	Outputs during error indicator is lighting up or blinking.	Keep these outputs Open when NOT used.

Multiple Connecting of Non-contact Door Switches and G9SX-NS□

For connecting multiple non-contact door switch to G9SX-NS□, refer to the wiring examples on D40A/D40Z's manual.

Terminal arrangement and LED indicators

TYPE G9SX-NSA222-T03-□ TYPE G9SX-NS202-□



6 Performance Level and Safety Category of ISO 13849-1

The G9SX-NS□ together with D40A can be used up to PL=d and Category 3, and the G9SX-NS□ together with D40Z can be used for PL=e and Category 4, required by EN ISO 13849-1 European standard.

Refer to the following link for the Safety-related characteristic data:

http://www.fa.omron.co.jp/safety_6en/

This does NOT mean that G9SX-NS□ can always be used for required category under all the similar conditions and situations.

Conformity to the categories must be assessed as a whole system.

When using G9SX-NS□ for safety categories, make sure the conformity of the whole system.

1) Connect D40A/D40Z inputs and outputs with terminals D1, D2, D3 and D4.

2) Input the signals to both of the Safety inputs (T11-T12 and T21-T22)

3) Input a signal to the Safety inputs (T11-T12 and T21-T22) through switches with Direct Opening mechanism.

When using limit switches, at least one of them must have Direct Opening Mechanism.

4) Input the signal through a NC contact of the contactor to Feedback/Reset input (T31-T32 for manual reset or T31-T32 for auto reset). (Refer to '5 Examples of Application')

5) Be sure to Connect A2 to ground.

7 Fault Detection

When G9SX-NS detects a fault, ERR indicator and/or other indicators light up or blink to show the information of the fault.

Check and take needed measures referring to the following table, and then apply supply voltage to G9SX-NS□.

ERR indicator	Other indicators	Faults	Expected causes of the faults	Checking points and measures to take
Blink	—	Faults by electro-magnetic disturbance or of internal circuits.	1) By excessive electro-magnetic disturbance 2) Failures of the parts of internal circuits	1) Check the disturbance level around G9SX-NS□ and its related system. 2) Replace with a new product.
T1 Blink	—	Faults involved with Safety input 1	1) Failures involving the wiring of Safety input 1 2) Incorrect setting of Cross fault detection mode. 3) Failures of the parts of the circuits of Safety input 1.	1) Check the wiring to T11 and T12. (See Note1, 2) 2) Check the wiring to Y1. (See Note1) 3) Replace with a new product.
T2 Blink	—	Faults involved with Safety input 2	1) Failures involving the wiring of Safety input 2 2) Incorrect setting of Cross fault detection mode. 3) Failures of the parts of the circuits of Safety input 2.	1) Check the wiring to T21 and T22. (See Note1, 2) 2) Check the wiring to Y1. (See Note1) 3) Replace with a new product.
FB Blink	—	Faults involved with Feedback/Reset input	1) Failures involving the wiring of Feedback/Reset input 2) Failures of the parts of the circuits of Feedback/Reset input	1) Check the wiring to T31, T32, and T33 (See Note1, 2) 2) Replace with a new product.
Light up	—	Faults of Expansion units	1) Improper feedback signals from Expansion units 2) Abnormal supply voltage to Expansion units 3) Failures of the parts of the circuits of Safety relay contact outputs	1) Check the connecting cable of Expansion units and the connection of the termination socket. 2) Check the supply voltage to Expansion units. * Make sure that all Expansion units' PWR indicators are lighting. 3) Replace the Expansion unit with a new one.
EI Blink	—	Faults involved with Safety solid-state outputs or Logical connection outputs	1) Failures involving the wiring of Safety solid-state outputs 2) Failures of the parts of the circuits of Safety solid-state outputs 3) Failures involving the wiring of Logical connection output 4) Failures of the parts of the circuits of Logical connection output 5) Impermissible high ambient temperature	1) Check the wiring to S14 and S24 (See Note1) 2) Replace with a new product. 3) Check the wiring to L1. (See Note1, 2) 4) Replace with a new product. 5) Check the ambient temperature and spacing around G9SX-NS.
ED Blink	—	Faults involved with Off-delayed Safety solid-state outputs	1) Failures involving the wiring of Off-delayed Safety relay contact outputs 2) Incorrect set values of Off-delay time 3) Failures of the parts of the circuits of Off-delayed Safety relay contact outputs 4) Impermissible high ambient temperature	1) Check the wiring to S44 and S54 (See Note1) 2) Confirm the set values of the two of Off-delay time preset switches. (See Note3) 3) Replace with a new product. 4) Check the ambient temperature and spacing around G9SX-NSA222-T03-□.
AND Blink	—	Faults involved with Logic AND connection input	1) Failures involving the wiring of Logic AND connection input 2) Incorrect setting for Logic AND connection input 3) Failures of the parts of the circuits of Logical AND connection input	1) Check the wiring to T41 and T42 (See Note1, 2, 4) 2) Confirm the set value of the Logical AND connection preset switch. 3) Replace with a new product.
NS Blink	—	Faults involved with Non-contact Door Switch input	1) Failures involving the wiring of Non-contact Door Switch input 2) Failures involving the wiring of multiple Non-contact Door Switches 3) Failures of the parts of the circuits of G9SX-NS□ 4) Failures of the parts of the circuits of D40A/D40Z	1) Check the wiring to D1, D2, D3 and D4 (See Note1, 2) 2) Check the wiring between D40As 3) Replace with a new G9SX-NS□ 4) Replace with a new D40A/D40Z
The All (without PWR) indicators Blink	—	Supply voltage outside the rated value	1) Supply voltage outside the rated value	1) Check the supply voltage to Expansion units.

Note: (1) Check miswiring, short, or open, etc. (See 'Wiring of inputs and outputs')

(2) Make sure that the wiring length is 100 meters or less. (See 'Precautions for Correct Use(8)')

(3) See 'Preset Switches'.

(4) See '4 Ratings and Specifications' Note 9

When indicators other than ERR indicator while ERR indicator keeps lit off, check and take needed actions referring to the following table.

ERR indicator	The other indicators	Conditions	Expected causes of the faults	Expected causes of the faults
Light off	T1 Blink or / and T2 Blink	Mismatch between input 1 and input 2.	1) Input status between input 1 and input 2 is different, cause of contact failure or short circuit of safety input device(s) or any wiring fault.	1) Check the wiring from safety input devices to G9SX-NS□. Or check the inputs sequence of safety input devices. After removing the fault, turn both safety inputs to OFF state.